

Technical Reference Manual

ABB i-bus® KNX

ABB-Powernet® KNX

Control element, 2/4gang with
room temperature controller

6128/28-xxx-500

2CCA380393R0001


2CCA380394R0001

2CCA380395R0001

2CCA388429R0001

2CCA388430R0001

2CCA388431R0001

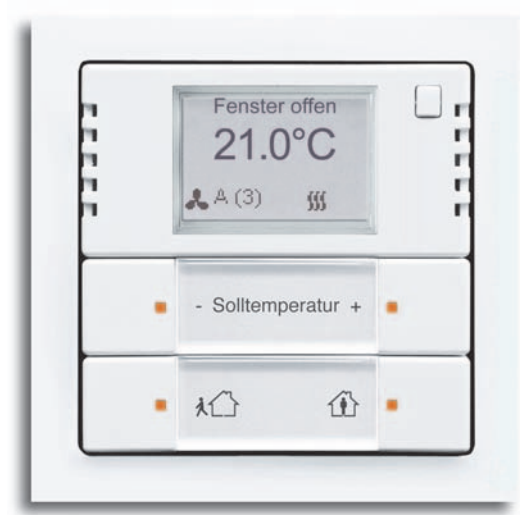

1	Notes on the instruction manual	8
2	Safety.....	9
2.1	Information and symbols used.....	9
2.2	Intended use.....	10
2.3	Improper use	10
2.4	Target group / Qualifications of personnel.....	11
2.4.1	Operation	11
2.4.2	Installation, commissioning and maintenance	11
2.5	Safety instructions	12
3	Information on protection of the environment	13
3.1	Environment	13
4	Setup and function	14
4.1	Features of function and equipment.....	14
4.2	Device overview	16
4.3	Additional components	16
5	Technical data.....	17
5.1	Technical data	17
5.2	Dimensional drawings	17
6	Connection, installation / mounting.....	18
6.1	Requirements for the electrician.....	18
6.2	Installation site.....	19
6.3	Mounting.....	21
6.4	Electrical connection.....	23
7	Commissioning	24
7.1	Software	24
7.1.1	Preparation	24
7.1.2	Assigning a physical address	24
7.1.3	Assigning the group address(es).....	24
7.1.4	Selecting the application program	24
7.1.5	Differentiating the application program.....	24
8	Operation	25
8.1	Control elements	25
8.2	Displays / messages.....	26
8.3	Button backlighting	26
8.4	General control and display functions	27
8.5	Operating the room temperature controller	29
8.6	Additional operating modes and alarms	32
9	Maintenance	33
9.1	Cleaning	33
9.2	Maintenance-free device	33
10	Description of application and parameters.....	34
10.1	Application program.....	34
10.2	Application "RTC"	35

10.2.1	General - Device function	35
10.2.2	General - Control function.....	35
10.2.3	General - Operating mode after reset.....	36
10.2.4	General - Additional functions.....	36
10.2.5	General - Send cyclic "In operation" (min).....	37
10.2.6	Heating control.....	37
10.2.7	Heating control - Control value type	37
10.2.8	Heating control - Heating type	38
10.2.9	Heating control - P-component (x 0.1°C)	38
10.2.10	Heating control - I-component (min.)	39
10.2.11	Heating control - Extended settings.....	39
10.2.12	Basic stage heating.....	39
10.2.13	Basic stage heating - Status object heating.....	39
10.2.14	Basic stage heating - Mode of the control value.....	39
10.2.15	Basic stage heating - Hysteresis (x 0.1°C).....	40
10.2.16	Basic stage heating - Control value difference for sending of heating control value	40
10.2.17	Basic stage heating - Cyclic sending of the control value (min)	40
10.2.18	Basic stage heating - PWM cycle heating (min)	41
10.2.19	Basic stage heating - Maximum control value (0 - 255)	41
10.2.20	Basic stage heating - Minimum control value for basic load (0 to 255)	41
10.2.21	Control of additional heating stage	41
10.2.22	Control of additional heating stage - Control value type.....	42
10.2.23	Control of additional heating stage - Additional heating type	43
10.2.24	Control of additional heating stage - P-component (x 0.1°C).....	43
10.2.25	Control of additional heating stage - P-component (min)	44
10.2.26	Control of additional heating stage - Temperature difference to basic stage (x 0.1°C)	44
10.2.27	Control of additional heating stage - Extended settings	44
10.2.28	Additional heating stage	44
10.2.29	Additional heating stage - Mode of the control value.....	44
10.2.30	Additional heating stage - Hysteresis (x 0.1°C).....	45
10.2.31	Additional heating stage - Control value difference for sending of heating control value.....	45
10.2.32	Additional heating stage - Cyclic sending of the control value (min)	46
10.2.33	Additional heating stage - Minimum control value for basic load (0 - 255).....	46
10.2.34	Cooling control	47
10.2.35	Cooling control - Control value type.....	47
10.2.36	Cooling control - Cooling type.....	48
10.2.37	Cooling control - P-component (x 0.1°C).....	48
10.2.38	Cooling control - I-component (min.)	48
10.2.39	Cooling control - Extended settings	49
10.2.40	Basic stage cooling	49
10.2.41	Basic stage cooling - Status object cooling	49
10.2.42	Basic stage cooling - Mode of the control value	49
10.2.43	Basic stage cooling - Hysteresis (x 0.1°C)	50
10.2.44	Basic stage cooling - Cyclic sending of the control value (min).....	50
10.2.45	Basic stage cooling	51
10.2.46	Basic stage cooling - Maximum control value (0 - 255).....	51
10.2.47	Basic stage cooling - Minimum control value for basic load (0 to 255)	51
10.2.48	Control of additional cooling stage.....	52
10.2.49	Control of additional cooling stage - Cooling type	53
10.2.50	Control of additional cooling stage - P-component (x 0.1°C)	53
10.2.51	Control of additional cooling stage - P-component (min).....	53
10.2.52	Control of additional cooling stage - Extended settings.....	54

10.2.53	Additional cooling stage	54
10.2.54	Additional cooling stage - Mode of the control value	54
10.2.55	Additional cooling stage - Hysteresis (x 0.1°C)	54
10.2.56	Additional cooling stage - Control value difference for sending of cooling control value.....	55
10.2.57	Additional cooling stage - Cyclic sending of the control value (min).....	55
10.2.58	Additional cooling stage - Maximum control value (0 - 255).....	55
10.2.59	Additional cooling stage - Minimum control value for basic load (0 - 255)	56
10.2.60	Settings of basic load	56
10.2.61	Settings of basic load - Minimum control value for basic load > 0.....	56
10.2.62	Combined heating and cooling modes	56
10.2.63	Combined heating and cooling modes - Switchover of heating/cooling	57
10.2.64	Combined heating and cooling modes - Operating mode after reset	57
10.2.65	Combined heating and cooling modes - Heating/cooling control value output.....	57
10.2.66	Combined heating and cooling modes - Additional heating/cooling stage control value output	58
10.2.67	Setpoint settings	58
10.2.68	Setpoint settings - Setpoint for heating comfort = setpoint for cooling comfort	58
10.2.69	Setpoint settings - Hysteresis for switchover heating/cooling (x 0.1°C).....	59
10.2.70	Setpoint settings - Setpoint temperature for heating and cooling comfort (°C).....	59
10.2.71	Setpoint settings - Setpoint temperature for heating comfort (°C)	59
10.2.72	Setpoint settings - Reduction for standby heating (°C)	59
10.2.73	Setpoint settings - Reduction for ECO heating (°C)	60
10.2.74	Setpoint settings - Set-point temperature for frost protection (°C)	60
10.2.75	Setpoint settings - Setpoint temperature for cooling comfort (°C).....	60
10.2.76	Setpoint settings - Increase for standby cooling (°C).....	60
10.2.77	Setpoint settings - Increase for ECO cooling (°C)	61
10.2.78	Setpoint settings - Set-point temperature for heat protection (°C)	61
10.2.79	Setpoint settings - Display indicates	61
10.2.80	Setpoint settings - Display indicates	61
10.2.81	Setpoint settings - Send current setpoint.....	62
10.2.82	Setpoint settings - Cyclic sending of the current set-point temperature (min).....	62
10.2.83	Setpoint adjustment	62
10.2.84	Setpoint adjustment — Maximum manual increase during heating mode (0 - 15°C)	62
10.2.85	Setpoint adjustment — Maximum manual reduction during heating mode (0 - 15°C).....	62
10.2.86	Setpoint adjustment — Maximum manual increase during cooling mode (0 - 15°C).....	63
10.2.87	Setpoint adjustment — Maximum manual reduction during cooling mode (0 - 15°C)	63
10.2.88	Setpoint adjustment - Resetting of the manual adjustment for receipt of a basic setpoint.....	63
10.2.89	Setpoint adjustment - Resetting the manual adjustment for change of operating mode.....	64
10.2.90	Setpoint adjustment - Resetting the manual adjustment via object.....	64
10.2.91	Setpoint adjustment - Permanent storage of on-site operation	64
10.2.92	Temperature reading - Inputs of temperature reading.....	64
10.2.93	Temperature reading - Inputs of weighted temperature reading	65
10.2.94	Temperature reading - Weighting of internal measurement (0 to 100%)	65
10.2.95	Temperature reading - Weighting of external measurement (0 to 100%)	65
10.2.96	Temperature reading - Weighting of external measurement 2 (0 to 100%)	65
10.2.97	Temperature reading - Cyclic sending of the actual temperature (min)	66
10.2.98	Temperature reading - Difference of value for sending the actual temperature (x 0.1°C)	66
10.2.99	Temperature reading - Adjustment value for internal temperature measurement (x 0.1°C).....	66
10.2.100	Temperature reading - Monitoring time for temperature reading (0 = no monitoring).....	66
10.2.101	Temperature reading — Operating mode for fault.....	67
10.2.102	Temperature reading - Control value for fault (0 - 255)	67
10.2.103	Alarm functions	67
10.2.104	Alarm functions - Condensate water alarm.....	67

10.2.105	Alarm functions — Dew point alarm	68
10.2.106	Alarm functions - Frost alarm temperature for HVAC and RHCC status (°C)	68
10.2.107	Alarm functions - Heat alarm temperature for RHCC status (°C).....	68
10.2.108	Fan coil settings - Fan speed levels	68
10.2.109	Fan coil settings - Fan speed levels Number of fan speed levels	68
10.2.110	Fan coil settings - Fan speed levels - Format of the level output	69
10.2.111	Fan coil settings - Fan speed levels - Level output	69
10.2.112	Fan coil settings - Fan speed levels - Lowest manually adjustable level	69
10.2.113	Fan coil settings - Fan speed levels - Level status evaluation	70
10.2.114	Fan coil settings heating	70
10.2.115	Fan coil settings for heating - Speed level 1 to 5 up to control value (0 to 255) heating.....	70
10.2.116	Fan coil settings for heating - Fan speed level limit heating for eco mode.....	70
10.2.117	Fan coil settings for heating - Maximum speed level heating for eco mode.....	71
10.2.118	Fan coil settings for cooling	71
10.2.119	Fan coil settings for cooling - Speed level 1 to 5 up to control value (0 to 255) cooling.....	71
10.2.120	Fan coil settings for cooling - Fan speed level limit cooling for eco mode	71
10.2.121	Fan coil settings for cooling - Maximum fan speed level cooling for eco mode	71
10.2.122	Summer compensation	72
10.2.123	Summer compensation - Summer compensation	72
10.2.124	Summer compensation - (Lower) Starting temperature for summer compensation (°C).....	73
10.2.125	Summer compensation - Offset of the set-point temperature for the entry into summer compensation (x 0.1°C).....	73
10.2.126	Summer compensation - (Upper) exit temperature for summer compensation (°C).....	73
10.2.127	Summer compensation - Offset of the set-point temperature for the exit from summer compensation (x 0.1°C).....	74
10.3	Additional RTC application "Control settings".....	75
10.3.1	General – Jump-back to the primary function.....	75
10.3.2	Temperature display – Temperature unit.....	75
10.3.3	General - Setting the temperature unit via object.....	75
10.3.4	General - Setpoint display	75
10.3.5	General - Display of actual temperature	76
10.3.6	General - Waiting period for display of actual temperature	76
10.3.7	General - Display of actual temperature in eco mode	76
10.3.8	Brightness setting – Day/Night mode	77
10.3.9	Brightness setting – Brightness of display backlighting.....	77
10.3.10	Extended settings - Colour scheme of display backlighting	78
10.4	Communication objects - RTC.....	79
10.4.1	Heating control value	79
10.4.2	Additional heating stage	79
10.4.3	Cooling control value	79
10.4.4	Additional cooling stage.....	80
10.4.5	Control On/Off.....	80
10.4.6	Actual temperature.....	80
10.4.7	External actual temperature.....	81
10.4.8	External actual temperature 2.....	81
10.4.9	Fault, actual temperature.....	81
10.4.10	Local actual temperature	81
10.4.11	Current setpoint	82
10.4.12	Operating mode	82
10.4.13	Superimposed operating mode.....	83
10.4.14	Window contact.....	83
10.4.15	Presence detector.....	84

10.4.16	Heating status	84
10.4.17	Cooling status	84
10.4.18	Basic load	85
10.4.19	Switchover heating/cooling	85
10.4.20	Fan coil manual.....	86
10.4.21	Fan coil step.....	86
10.4.22	Fan coil step status	87
10.4.23	Fan speed level 1.....	87
10.4.24	Fan speed level 2.....	87
10.4.25	Fan speed level 3.....	87
10.4.26	Fan speed level 4.....	87
10.4.27	Fan speed level 5.....	88
10.4.28	Basic setpoint.....	88
10.4.29	Resetting manual setpoints	88
10.4.30	Dew point alarm.....	88
10.4.31	Condensate water alarm.....	89
10.4.32	Outside temperature for summer compensation	89
10.4.33	Summer compensation active	90
10.4.34	Setpoint reached.....	90
10.4.35	Fahrenheit.....	90
10.4.36	Display backlighting	91
10.4.37	On/Off request	91
10.4.38	Setpoint display.....	91
10.4.39	Request setpoint	91
10.4.40	Confirm setpoint.....	91
10.4.41	Heating/cooling request	92
10.4.42	Request fan speed level manual	92
10.4.43	Request fan speed level	92
10.4.44	Confirm fan speed level	92
10.4.45	Controller status RHCC	93
10.4.46	Controller status HVAC.....	93
10.4.47	Commissioned	93
10.5	Additional RTC communication objects "Control settings"	94
10.5.1	Day/Night mode	94
10.6	Application for "Button top right"	95
10.6.1	Application "1-button switching".....	95
10.6.2	Application "1-button dimming"	96
10.6.3	Application "2-button value transmitter"	97
10.6.4	Application "1-button value transmitter, 2 objects"	99
10.6.5	Application "1-button light scene extension unit with memory function"	102
10.6.6	Application "1-button step switch".....	103
10.6.7	Application "1-button short-long operation"	104
10.7	Application for "General functions"	105
10.7.1	Cyclic telegram	105
10.7.2	Priority	106
10.7.3	Logic	107
10.7.4	Gate	108
10.7.5	Staircase lighting.....	109

10.7.6	Delay	110
10.7.7	Min/Max value transducer	111
10.7.8	Threshold value / hysteresis	112
10.7.9	Light scene actuator.....	113
11	Index	114

1 Notes on the instruction manual

Please read through this manual carefully and observe the information it contains. This will assist you in preventing injuries and damage to property, and ensure both reliable operation and a long service life for the device.

Please keep this manual in a safe place.

If you pass the device on, also pass on this manual along with it.

ABB accepts no liability for any failure to observe the instructions in this manual.

If you require additional information or have questions about the device, please contact ABB or visit our Internet site at:

www.BUSCH-JAEGER.com

2 Safety

The device has been constructed according to the latest valid regulations governing technology and is operationally reliable. It has been tested and left the factory in a technically safe and reliable state.

However, residual hazards remain. Read and adhere to the safety instructions to prevent hazards of this kind.

ABB accepts no liability for any failure to observe the safety instructions.

2.1 Information and symbols used

The following Instructions point to particular hazards involved in the use of the device or provide practical instructions.



Danger

Risk of death / serious damage to health

- The respective warning symbol in connection with the signal word "Danger" indicates an imminently threatening danger which leads to death or serious (irreversible) injuries.



Warning

Serious damage to health

- The respective warning symbol in connection with the signal word "Warning" indicates a threatening danger which can lead to death or serious (irreversible) injuries.



Caution

Damage to health

- The respective warning symbol in connection with the signal word "Caution" indicates a danger which can lead to minor (irreversible) injuries.



Attention

Damage to property

- This symbol in connection with the signal word "Attention" indicates a situation which could cause damage to the product itself or to objects in its surroundings.



NOTE

This symbol in connection with the word "Note" indicates useful tips and recommendations for the efficient handling of the product.

The following safety symbols are used in the operating manual.



This symbol alerts to electric voltage.

2.2 Intended use

The device is intended for the following:

- the control of a ventilator convector with a fan coil actuator.
- the control of conventional heating and cooling installations.
- operation according to the listed technical data.
- the installation in dry interior rooms.
- mounting on a flush-mounted bus/network coupler, which is to be ordered separately.

The intended use also includes adherence to all specifications in this manual.



NOTE

- The integrated bus coupler makes possible the connection to a KNX bus line.
- Extensive functions are available for the room temperature controller and the control elements. For the range of applications see see chapter 10 “Description of application and parameters” on page 34.

2.3 Improper use

Each use not listed in Chapter 2.2 “Intended use” on page 10 is deemed improper use and can lead to personal injury and damage to property.

ABB is not liable for damages caused by use deemed contrary to the intended use of the device. The associated risk is borne exclusively by the user/operator.

The device is not intended for the following:

- Unauthorized structural changes
- Repairs
- Outdoor use
- The use in bathroom areas
- inserting of objects through device openings

2.4 Target group / Qualifications of personnel

2.4.1 Operation

No special qualifications are needed to operate the device.

2.4.2 Installation, commissioning and maintenance

Installation, commissioning and maintenance of the device must only be carried out by trained and properly qualified electrical installers.

The electrical installer must have read and understood the manual and follow the instructions provided.

The electrical installer must adhere to the valid national regulations in his/her country governing the installation, functional test, repair and maintenance of electrical products.

The electrical installer must be familiar with and correctly apply the "five safety rules" (DIN VDE 0105, EN 50110):

1. Disconnect
2. Secure against being re-connected
3. Ensure there is no voltage
4. Connect to earth and short-circuit
5. Cover or barricade adjacent live parts

2.5 Safety instructions



Danger - Electric voltage!

Electric voltage! Risk of death and fire due to electric voltage of 230 V.

Dangerous currents flow through the body when coming into direct or indirect contact with live components. This can result in electric shock, burns or even death.

- Work on the 230 V supply system may only be performed by authorised and qualified electricians.
- Disconnect the mains power supply before installation / disassembly.
- Never use the device with damaged connecting cables.
- Do not open covers firmly bolted to the housing of the device.
- Use the device only in a technically faultless state.
- Do not make changes to or perform repairs on the device, on its components or its accessories.
- Keep the device away from water and wet surroundings.



Caution! - Risk of damaging the device due to external factors!

Moisture and contamination can damage the device.

- Protect the device against humidity, dirt and damage during transport, storage and operation.

3 Information on protection of the environment

3.1 Environment



Consider the protection of the environment!

Used electric and electronic devices must not be disposed of with domestic waste.

- The device contains valuable raw materials which can be recycled. Therefore, dispose of the device at the appropriate collecting depot.

All packaging materials and devices bear the markings and test seals for proper disposal. Always dispose of the packaging material and electric devices and their components via the authorized collecting depots and disposal companies.

The products meet the legal requirements, in particular the laws governing electronic and electrical devices and the REACH ordinance.

(EU Directive 2002/96/EC WEEE and 2002/95/EC RoHS)

(EU REACH ordinance and law for the implementation of the ordinance (EC) No.1907/2006).

4 Setup and function

4.1 Features of function and equipment

The Control element, 2/4gang with room temperature controller is mounting on a flush-mounted bus/network coupler, which is to be ordered separately.

The room temperature controller senses the current room temperature and regulates the heating or cooling. The device also serves to control two-/four-pipe systems (2-/4-pipe fan coil units) and conventional air-conditioning units. Additionally, further switch-control telegrams can be sent to KNX actuators, to activate a connected ventilator, for example.

Hotel management systems can gain direct access to the room temperature controller via KNX and activate controllers in the room. The fan speed level can also be selected manually via buttons (forced operation).

This makes it possible to very quickly adjust the temperature in a hotel room to the individual wishes of the guests. The device supports the full function for international hotel applications. It can function in the operating modes "heating/cooling", "only heating" and "only cooling".

For operation and display, the room temperature controller is equipped with push-buttons and a rotary control element. An LCD display serves to indicate the current operating states and values. The use of simple icons on the buttons and in the display allow the room temperature controller to be operated easily and intuitively.

The Control element, 2/4gang with room temperature controller can, depending on the configuration, be used in a variety of ways:

- As a normal sensor with the freely programmable functions.
 - Here an additional button must be pressed to switch to the RTC adjustment level (*).
- As pure room temperature controller.
 - Here the sensor is in the RTC adjustment level right from the start.


(*) There is the added option of setting the setpoint adjustment on the switching/dimming operating level (1st level without actuating the additional button). The On/Off + heating/cooling switchover function is carried out with the "Switching" button function.

The following table lists the options for use:

Special features	Function	General functions
▪ Function illumination	▪ Set / actual temperature	▪ Light scene actuator
▪ Freely programmable	▪ Comfort/standby	▪ Sequence
▪ Day / night switchover of the LEDs	▪ Night mode	▪ Logic
▪ Theft protection	▪ Frost protection	▪ Delay
▪ Labelling possible	▪ Heat protection	▪ Staircase lighting
	▪ Heating	▪ Preset
	▪ Cooling	▪ Cyclic telegram
	▪ Fan control	▪ Flashing
	▪ Logic functions	▪ Gate
		▪ Min/Max value transducer
		▪ Threshold value / hysteresis
		▪ PWM inverter
		▪ Priority
	In addition to the room temperature controller function the control elements can, depending on the configuration, be occupied with additional applications.	
	▪ Switching	
	▪ Dimming	
	▪ Blind	
	▪ Value transmitter	
	▪ Setting the RTC operating mode	
	▪ Light scene extension unit	
	▪ Logic functions	
	▪ LED colour concept	
	▪ Switching sequences	
	▪ Multiple operation	
	▪ among others	

Table 1: Options for use

4.2 Device overview

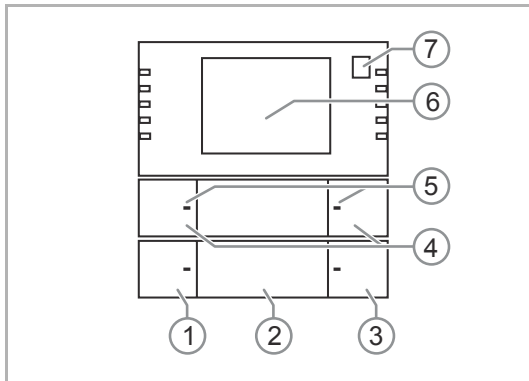

- [1] ECO button
- [2] Labelling field
- [3] Menu button
- [4] Setpoint adjustment
- [5] LED
- [6] Display
- [7] Switchover button

Fig. 1: Overview of devices (front view)



NOTE

Please observe the special mounting instructions at Chapter 6 “Connection, installation / mounting” on page 18.

4.3 Additional components



NOTE

Also a cover frame and a flush-mounted bus/network coupler are required. These must be ordered separately.

5 Technical data

5.1 Technical data

Designation	Value
Power supply	
▪ Bus coupler:	24 V DC (via bus line)
▪ Network coupler:	230 V AC / 50 Hz
Bus subscribers:	Maximum 12 mA
KNX connection	
▪ Bus coupler:	Bus connecting terminal, screwless
▪ Network coupler:	Screw terminals on the flush-mounted insert
Temperature range:	-5°C - +45°C
Protection type:	IP20
Storage temperature:	-20°C - +70°C

Table 2: Technical data

5.2 Dimensional drawings

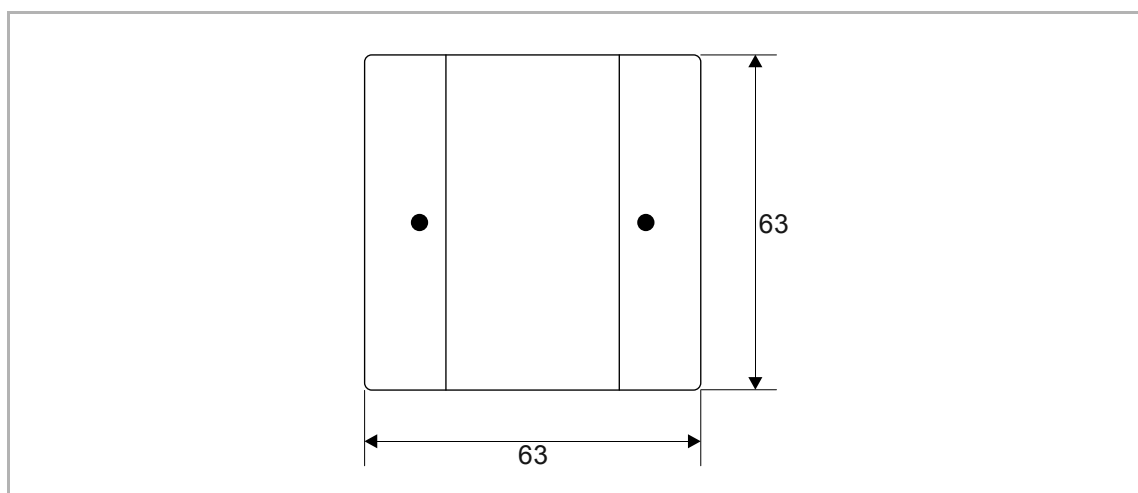


Fig. 2: Dimensions



NOTE

All dimensions are in mm.

6 Connection, installation / mounting



Danger - Electric voltage!

Risk of death due to electrical voltage of 230 V during short-circuit in the low-voltage line.

- Low-voltage and 230 V cables must not be installed together in a flush-mounted socket!

6.1 Requirements for the electrician



Danger - Electric voltage!

Install the device only if you have the necessary electrical engineering knowledge and experience.

- Incorrect installation endangers your life and that of the user of the electrical system.
- Incorrect installation can cause serious damage to property, e.g. due to fire.

The minimum necessary expert knowledge and requirements for the installation are as follows:

- Apply the "five safety rules" (DIN VDE 0105, EN 50110):
 1. Disconnect
 2. Secure against being re-connected
 3. Ensure there is no voltage
 4. Connect to earth and short-circuit
 5. Cover or barricade adjacent live parts.
- Use suitable personal protective clothing.
- Use only suitable tools and measuring devices.
- Check the type of supply network (TN system, IT system, TT system) to secure the following power supply conditions (classic connection to ground, protective earthing, necessary additional measures, etc.).

6.2 Installation site

For proper commissioning please observe the following points:

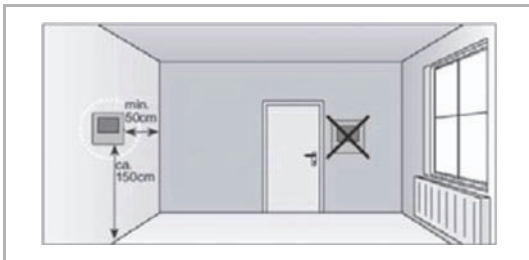


Fig. 3: Installation site - Distance

- The room temperature controller should be installed at a height of approximately 150 cm from the floor and 50 cm from a door frame.

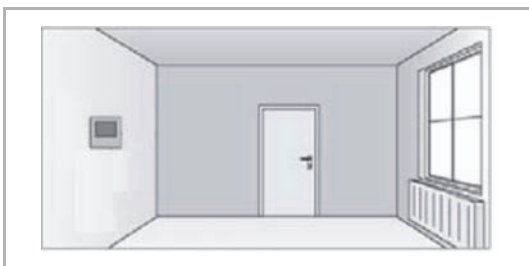


Fig. 4: Installation site – Position of radiator

- The room temperature controller should be installed on a wall opposite a radiator.

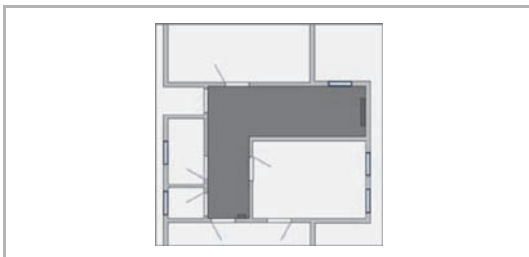


Fig. 5: Installation site - Room architecture

- The angles of room architecture should not separate a radiator and the room temperature controller from each other.

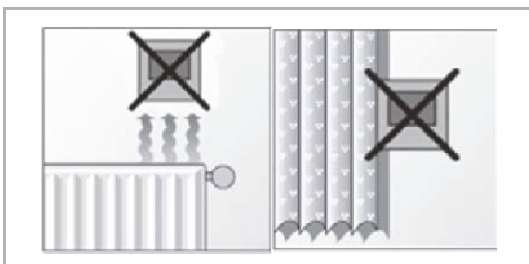


Fig. 6: Installation site – Position of RTC

- Installing a room temperature controller close to a radiator or behind curtains is not practical.



Fig. 7: Installation site - Exterior wall

- This also applies to the installation on an exterior wall.
 - Low outside temperatures have an effect on temperature regulation.

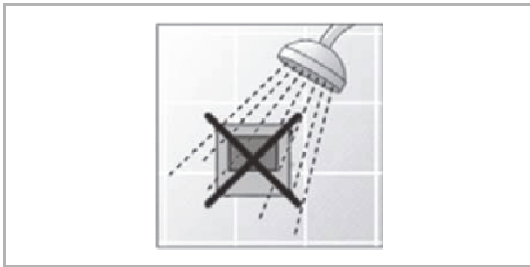


Fig. 8: Installation site – Wetting with fluids

- Wetting the room temperature controller with fluids is to be avoided.

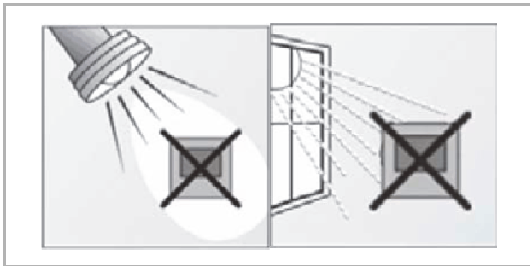


Fig. 9: Installation site - Direct sunlight

- Just as heat radiated from electric loads can impair the temperature regulation, so can direct sunlight on the room temperature controller.

6.3 Mounting



Caution! The device can sustain damage when coming into contact with hard objects!

The plastic parts of the device are sensitive.

- Pull the attachment off only with your hands.
- Do not lever parts off with screwdrivers or similar hard objects.

Installation only in dry interior rooms on a flush-mounted bus/network coupler, which is to be ordered separately.

- Observe the currently valid regulations.
- Observe the installation instructions.
- The cover frame must be ordered separately.

Installing the unit

To install the device, perform the following steps:

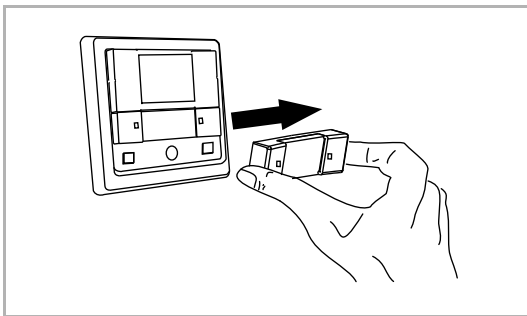


Fig. 10: Pulling the rocker off

1. Pull the bottom rocker off the device.

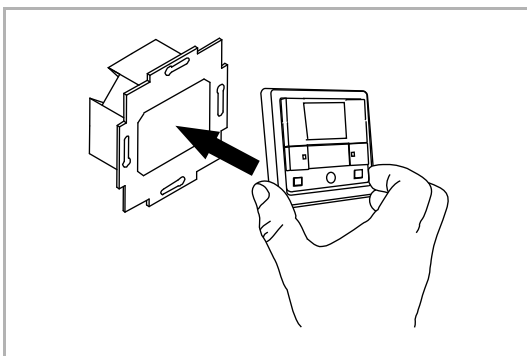


Fig. 11: Plugging the device on

2. Plug the device onto the bus/network coupler.

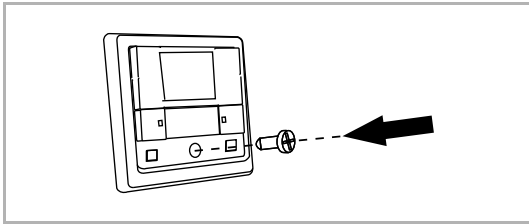


Fig. 12: Fixing the device

3. Fix the device with the supplied screw.

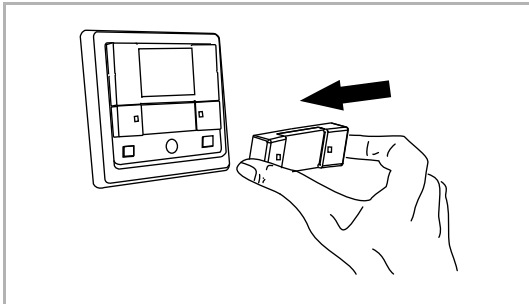


Fig. 13: Plugging the rocker on

4. Plug the rocker back onto the device.

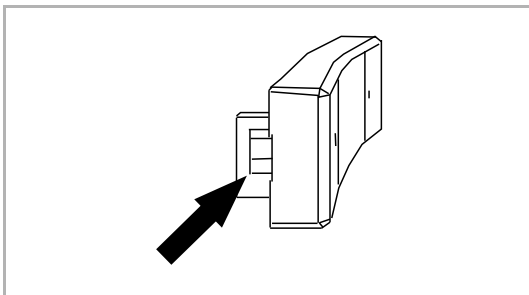


Fig. 14: Twist protection of the rocker

- The rockers have twist protection to ensure that they are attached the right way around. The lower web is wider.

The device is now mounted.

Installing the label

To install the label, perform the following steps:

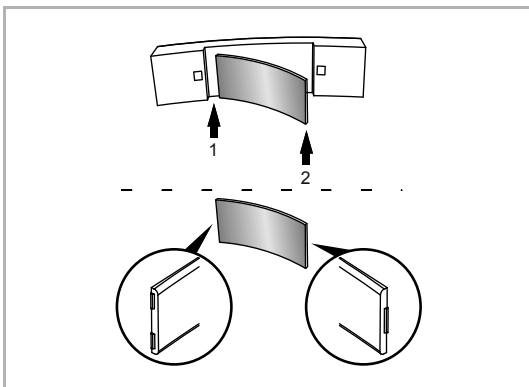


Fig. 15: Installing the labelling field

1. Remove the protective cover of the labelling field.
2. Replace the label and reinsert the protective cover.
 - To ensure that the protective cover is inserted the right way around, the notches are designed differently. Hold the protective cover as shown in the illustration.
 - First insert the left [1] and then the right side [2].

The label is installed.

6.4 Electrical connection

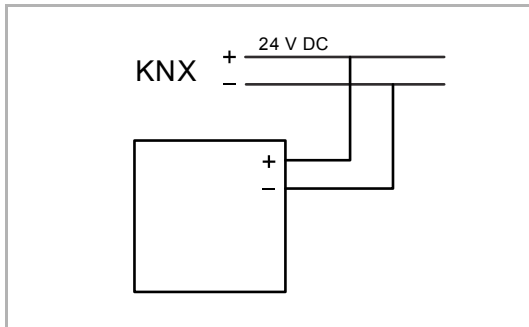


Fig. 16: Connection of bus coupler

Carry out the electrical connection according to the circuit diagram.

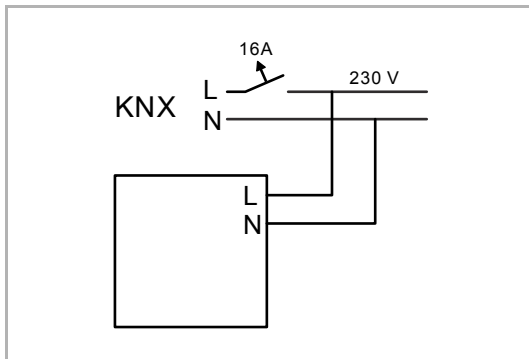


Fig. 17: Connection of network coupler

Carry out the electrical connection according to the circuit diagram.

7 Commissioning

7.1 Software

To start the device a physical address must be assigned first. The physical address is assigned and the parameters are set with the Engineering Tool Software ETS (ETS 3.0 f with Power Tool or ETS 4.0 without additional software).



NOTE

The devices are products of the KNX system and meet KNX guidelines. Detailed expert knowledge by means of KNX training sessions for a better understanding is assumed.

7.1.1 Preparation

1. Connect a PC to the KNX bus line via the KNX interface (e.g. via commissioning interface / commissioning adapter 6149/21-500).
 - The Engineering Tool Software ETS (ETS 3.0 f with Power Tool or ETS 4.0 without additional software) must be installed on the PC.
2. Switch on the bus voltage.

7.1.2 Assigning a physical address



NOTE

Please observe the operating manual for the flush-mounted bus/network coupler which is to be ordered separately.

7.1.3 Assigning the group address(es)

The group addresses are assigned in connection with the ETS.

7.1.4 Selecting the application program

Please contact our Internet support unit (www.BUSCH-JAEGER.com). The application is loaded into the device via the ETS.


7.1.5 Differentiating the application program

Various functions can be implemented via the software application (ETS).

- Detailed description of parameters: see chapter 10 “Description of application and parameters“ on page 34

8 Operation

8.1 Control elements

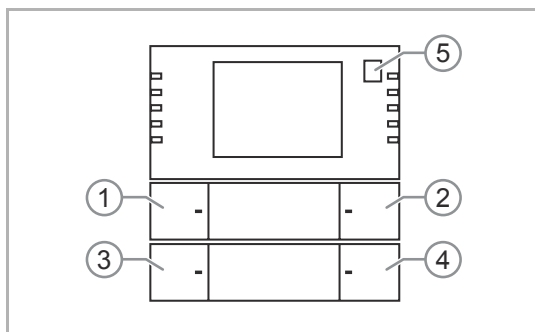

- [1] Setpoint adjustment
- [2] Setpoint adjustment
- [3] ECO button
- [4] Menu button
- [5] Switchover button

Fig. 18: Control elements (front view)

The room temperature controller is operated via buttons [1 + 2 + 3 + 4] beneath the display.

The additional button [5] next to the display is used for switching over to the menu level.

8.2 Displays / messages















Display	Function	Action of the device
	Comfort mode	<ul style="list-style-type: none"> – Heating/cooling is at the normal level. – The display is only visible when the "Superimposed operating mode" is active. Local operation is blocked.
	Standby mode	<ul style="list-style-type: none"> – The heating/cooling output is slightly lowered.
	Dew point mode	<ul style="list-style-type: none"> – The room temperature is not lowered any further.
	Frost protection mode	<ul style="list-style-type: none"> – The temperature is kept above a minimum value.
	Heat protection mode	<ul style="list-style-type: none"> – The temperature is kept below a maximum value.
	Condensate	<ul style="list-style-type: none"> – The condensate tank is full. The device operates in heat protection mode.
	OFF	<ul style="list-style-type: none"> – The control is deactivated. The device operates in frost protection mode.
	ECO mode	<ul style="list-style-type: none"> – The heating/cooling output is extremely lowered.
	Switchover heating/cooling	<ul style="list-style-type: none"> – Manual switchover.
		
	Fan speed levels 1-4	<ul style="list-style-type: none"> – Manual ventilation control.
		
		
	Automatic fan speed levels	<ul style="list-style-type: none"> – Automatic ventilation control.

Table 3: Overview of displays

8.3 Button backlighting

The day / night mode can be activated via a parameter setting. This allows the switchover between bright (day) and darkened backlighting (night).

When the device is deactivated, the backlighting of the buttons remains deactivated until the device is activated again.

8.4 General control and display functions

Operation is carried out by pressing the individual buttons.

The functions of the buttons in connection with the display are described in the following.

The precise function is fixed via the assigned application / function and their parameter settings.

Extensive applications are available for the room temperature controller and the control elements. For the overview and scope of the applications, see chapter 10 "Description of application and parameters" on page 34.

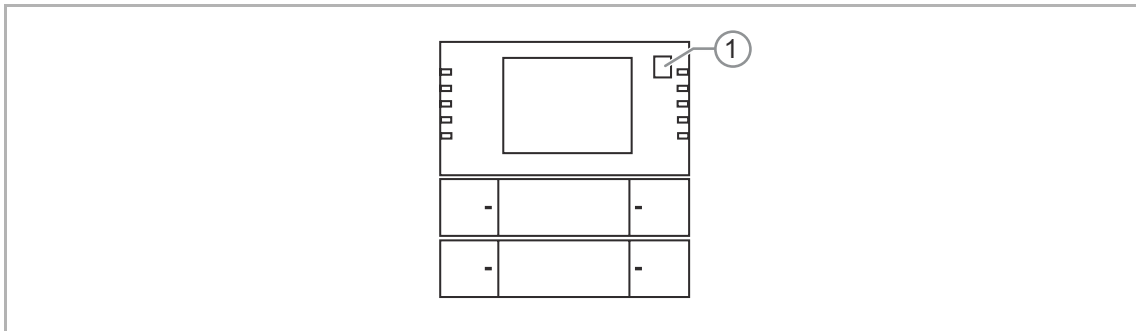


Fig. 19: Additional push-button

Sensor can, depending on the configuration, be used in a variety of ways:

- As a normal sensor with the freely programmable functions.
 - Here an additional button [1] must be pressed to switch to the RTC adjustment level (*).
- As pure room temperature controller.
 - Here the sensor is in the RTC adjustment level right from the start.

(*) There is the added option of setting the setpoint adjustment on the switching/dimming operating level (1st level without actuating the additional button). The "On/Off" + "Heating/cooling switchover" function is carried out with the "Switching" button function.

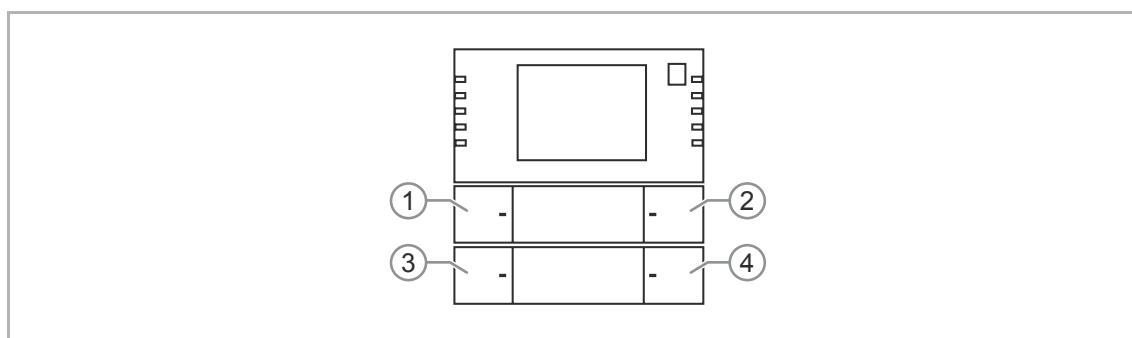


Fig. 20: Rocker switch functions of the RTC adjustment level

Adjusting the setpoint	The setpoint is adjusted via the top rocker [1 / 2].
Adjusting the operating modes	The operating modes are adjusted via the bottom rocker [3].
Confirming the menu selection	The selection of the menu is confirmed via the bottom rocker [4].
Switching device On/Off	The device is switched on and off with a long press of the left button [3].
Switching to ECO mode	The device is switched to ECO mode with a brief press of the left button [3].
<ul style="list-style-type: none"> ▪ Fan speed levels ▪ Switchover heating/cooling ▪ Setpoint adjustment 	The change between menus is carried out with a press of the right button [4]. <ul style="list-style-type: none"> – Each press of the button switches to the next function.

Table 4: RTC adjustment level: operation

8.5 Operating the room temperature controller

The display of the room temperature controller in the standard view indicates the current setpoint for the temperature or the icon of the current function and the operating status (also alarm!).

The current fan speed level is shown in the bottom left area of the display and the current operating mode in the bottom right area.

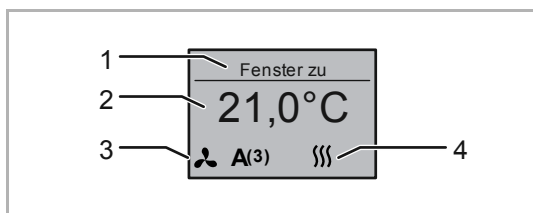


Fig. 21: Display overview

- [1] Text display / value display
- [2] Set-point temperature or icon *
- [3] Fan speed levels
- [4] Heating or cooling

* Or the actual temperature as screen saver



Indication of active functions in the display.

Function of rockers in the RTC adjustment level

The functions of the room temperature controller can be selected and adjusted in the adjustment level of the RTC. If the device has been configured as room temperature controller with a 2gang control element, one can only access the RTC adjustment level with a press of the additional button [5].

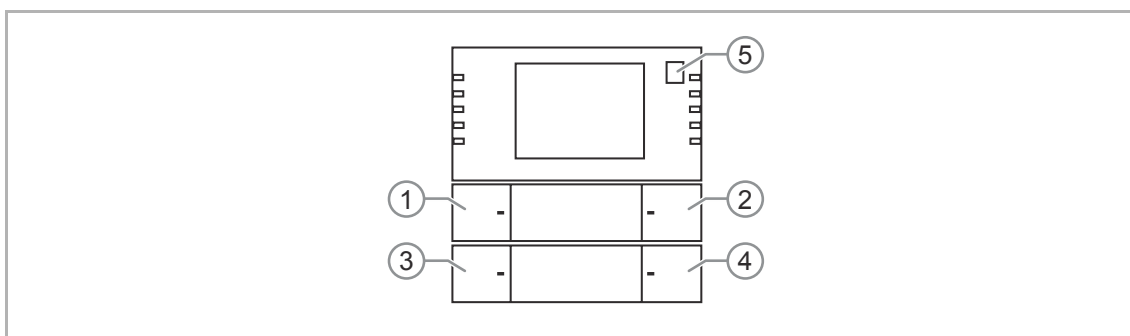


Fig. 22: RTC adjustment level: Rocker switch function

Button	Button press	Function
1	Short	Selection or temperature (-)
2	Short	Selection or temperature (+)
3	<ul style="list-style-type: none"> ▪ Short ▪ Long 	<ul style="list-style-type: none"> ▪ ECO ▪ On/Off
4	Short	Menu selection

Table 5: RTC adjustment level: Rocker switch function



NOTE

Menu sequence: Setpoint adjustment → Fan speed levels → Heating/cooling switchover → Setpoint adjustment → ...

- The menu function must be parameterized (otherwise only the setpoint adjustment is active)!
- The setpoint adjustment is the primary function. If it is not actuated the menu jumps automatically back to the setpoint adjustment.

Adjusting the temperature setpoints:

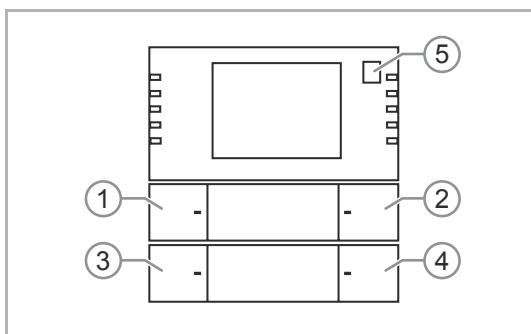


Fig. 23: Overview of buttons

1. Activate the function via the button [4], if it is not active.
 - Keep pressing the button [4] until the "Setpoint adjustment" function is displayed.
2. Adjust the setpoints.
 - Button [1] = Reduce value
 - Button [2] = Increase value

Switchover heating/cooling:

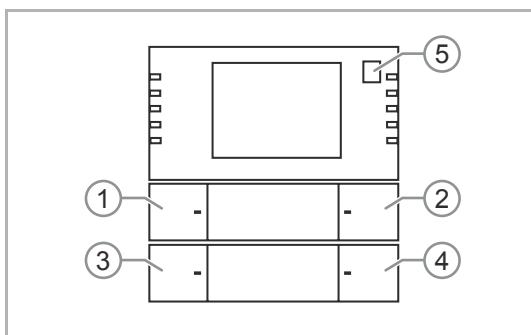


Fig. 24: Overview of buttons

1. Activate the function via the button [4], if it is not active.
 - Keep pressing the button [4] until the "Heating/cooling switchover" function is displayed.
2. Make your selection.
 - Button [1] = Heating
 - Button [2] = Cooling
 - At the bottom left either the icon for heating or cooling is displayed. Then the setpoint adjustment can be selected again, for example.

Selecting fan speed levels:

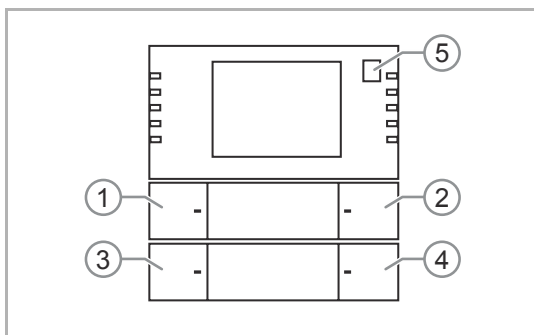


Fig. 25: Overview of buttons

1. Activate the function via the button [4], if it is not active.
 - Keep pressing the button [4] until the "Fan speed levels" function is displayed.
2. Select the fan speed level.
 - Button [1] = Fan speed level 1
 - Button [2] = Fan speed level 1
 - The icon for the selected fan speed level is displayed at the bottom right. Then the setpoint adjustment can be selected again, for example.

Activating ECO mode:

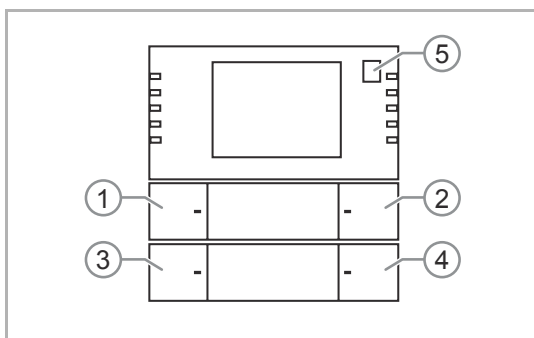


Fig. 26: Overview of buttons

1. Activate or deactivate the ECO mode with a brief press of the button [3].

Switching the device on/off:

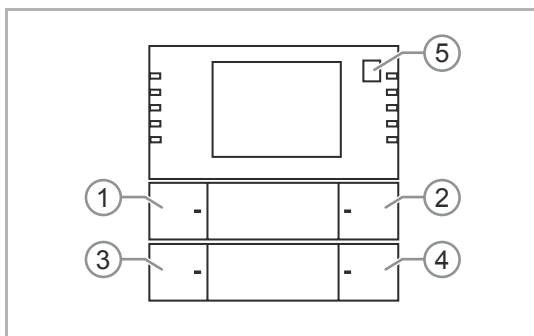









Fig. 27: Overview of buttons

1. Switch the device off and on again with a long press on the left button [3].

8.6 Additional operating modes and alarms

Display	Operating mode
	<p>Standby:</p> <ul style="list-style-type: none"> – Standby mode lowers the temperature during absence below the level of comfort mode. This saves energy. And the room does not cool down during an extended absence.
	<p>Dew point:</p> <ul style="list-style-type: none"> – If an appropriate telegram is received from a dew point sensor, the room temperature controller will display the corresponding icon and cease cooling and merely protect against the heat.
	<p>Alarm:</p> <ul style="list-style-type: none"> – The alarm can be freely parameterized. For example, it can occur when an external temperature sensor no longer sends values.
	<p>On/Off:</p> <ul style="list-style-type: none"> – The room temperature controller can be activated and deactivated. If control is deactivated, this icon appears in the display. The device operates in frost protection mode.
	<p>ECO mode:</p> <ul style="list-style-type: none"> – The heating/cooling output is extremely lowered.
	<p>Frost protection:</p> <ul style="list-style-type: none"> – If parameterized, frost protection will ensure that the temperature does not drop below the desired value. It is the lowest setpoint. <p>Heat protection:</p> <ul style="list-style-type: none"> – If parameterized, heat protection will ensure that the temperature does not exceed the desired value. It is the highest setpoint.
	<p>Condensate:</p> <ul style="list-style-type: none"> – The operation of a fan coil may cause condensate water, which is collected in a container. If the fan coil sends out a telegram when the container is full, the icon for condensate mode is displayed. The room temperature controller switches automatically into heat protection mode.



NOTE

Local operation is blocked!

- The alarm or the operating mode must first be deactivated.

9 Maintenance

9.1 Cleaning



Caution! - Risk of damaging the device!

- When spraying on cleaning agents, these can enter the device through crevices.
 - Do not spray cleaning agents directly onto the device.
- Aggressive cleaning agents can damage the surface of the device.
 - Never use caustic agents, abrasive agents or solvents.

Clean dirty devices with a soft dry cloth.

- If this is insufficient, the cloth can be moistened slightly with a soap solution.

9.2 Maintenance-free device

The device is maintenance-free. In case of damage, e.g. during transport or storage), do not perform repairs. Once the device is opened, the warranty is void.

Access to the device must be guaranteed for operation, testing, inspection, maintenance and repairs (according to DIN VDE 0100-520).

10 Description of application and parameters

10.1 Application program

The following application program is available:

Application program
Continuous / switching heating cooling TP/7

The application program for the room temperature controller contains the applications listed in the following:

KNX application
Continuous / switching heating cooling TP/7
Control settings
Button top right
General functions

Depending on which device and application are selected, the Engineering Tool Software "ETS" shows different parameters and communication objects. This allows the control element to be set accordingly with multi functions.

10.2 Application "RTC"

10.2.1 General - Device function

Options:	Single device
	Master device
	Slave device

- *Single device*: The device is used singly in a room as room temperature controller.
- *Master device*: At least two room temperature controllers are located in one room. One device is to be set up as a master device, while the others are to be programmed as slave devices / temperature sensors. The master device is to be linked to the slave devices using the appropriately labelled communication objects. The master device regulates the temperature.
- *Slave device/temperature sensor*: At least two room temperature controllers are located in one room. One device is to be set up as a master device, while the others are to be programmed as slave devices / temperature sensors. The slave devices are to be linked to the master device with the appropriately labelled communication objects. The slave device serves the room temperature control functions of the master.

10.2.2 General - Control function

Options:	Heating
	Heating with additional stage
	Cooling
	Cooling with additional stage
	Heating and cooling
	Heating and cooling with additional stage

- *Heating*: For operating a heat-based automatic single-room control. The temperature is regulated to the setpoint value defined in the parameter. The "Controller type" and "Heating type" can be programmed for optimal control.
- *Heating with additional stage*: In addition to the control function described under heating, the additional stage enables the activation of an additional heating circuit. This type of additional stage is used, for example, to quickly heat up a bathroom with floor heating via a heated towel rack.
- *Cooling*: For operating a cooling-based automatic single-room control. The temperature is regulated to the setpoint value defined in the parameter. The "Controller type" and "Cooling type" can be programmed for optimal control.
- *Cooling with additional stage*: In addition to the control function described under cooling, the additional stage enables the activation of an additional cooling device. This type of additional stage is used, for example, to quickly cool a room via an added cooling device.
- *Heating and cooling*: For operating a two-wire or four-wire system used to heat or cool a room. Switching between heating and cooling takes place using a central switch (two-wire system) or is carried out manually and / or automatically via the single room temperature controller (four-wire system).

- *Heating and cooling with an additional stage*: In addition to the heating and cooling functions, one additional stage each with an autonomous controller type can be programmed.



Note

This parameter is only available if the "Device function" parameter is set on "Single device" or "Master device".

10.2.3 General - Operating mode after reset

Options:	Comfort
	Standby
	Eco mode
	Cooling with additional stage
	Frost/heat protection

After a reset the device will run in the operating mode after a restart until a new operating mode is set as the result of device operation or by communication objects, as the case may be. This operating mode should be defined during the planning phase. An improperly defined operating mode can result in a loss of comfort or increased energy consumption.

- *Comfort*: If the room temperature is not automatically lowered and the room is therefore controlled independent of its use.
- *Standby*: If the room is controlled automatically, e.g. by a presence detector, as a function of its use.
- *Eco mode*: If the room is controlled automatically or manually as a function of its use.
- *Frost/heat protection*: If only the building protection function is necessary in the room after a reset.



Note

This parameter is only available if the "Device function" parameter is set on "Single device" or "Master device".

10.2.4 General - Additional functions

Options:	No
	Yes

- This parameter enables additional functions and communication objects, e.g. window contact and presence detector.

10.2.5 General - Send cyclic "In operation" (min)

Options:	Setting option between 5 - 3000 minutes
----------	---

- The "In operation" communication object serves to inform that the controller still operates. Value "1" is sent cyclic. This parameter is used to set the cycle for sending. If the cyclic telegram fails, the function of the device is faulty and the air-conditioning of the room can be maintained with a forced operation. However, for this the system and/or actuator must have "Forced operation" function.



Note

This parameter is only available if the "Additional function" parameter is set to "Yes".

10.2.6 Heating control



Note

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.7 Heating control - Control value type

Options:	2-point 1 bit, Off/On
	2-point 1 byte, (0/100%)
	PI continuous, 0-100%
	PI PWM, On/Off
	Fan coil

The actuation of the control valve is determined by the selection of the controller type.

- *2-Point 1 Bit, Off/On*: The 2-point control is the simplest type of control. The controller switches on when the room temperature drops below a certain level (setpoint temperature value minus hysteresis) and switches off when a particular value (setpoint temperature value plus hysteresis) is exceeded. The switch-on and switch-off commands are transmitted as 1-bit commands.
- *2-Point 1 Byte, 0/100%*: This is another two-point control as described above. In this case, however, the switch-on and switch-off commands are transmitted as 1-byte values (0% / 100%).
- *PI continuous, 0-100%*: The PI controller adjusts its output value between 0% and 100% to match the difference between the actual value and the setpoint value and enables a precise regulation of the room temperature to the setpoint value. It sends the control value to the bus as a 1-byte value (0% - 100%). To reduce the bus load, the control value is only transmitted if it has changed by a predefined percentage in relation to the previous sent value. The control value can also be transmitted cyclically.
- *PI PWM, On/Off*: This also is a PI controller. Here, the output is a 1-bit command. For this to occur, the calculated control value is converted into a pulse-interval signal.
- *Fan coil*: The fan coil controller operates like the PI continuous controller. In addition, it allows the separate activation of the fan in the fan coil unit (e.g. fan speed levels 1 - 3).

10.2.8 Heating control - Heating type

Options:	PI continuous, 0 – 100% and PI PWM, On/Off: <ul style="list-style-type: none"> ▪ Area (e.g. floor heating) 4°C 200 min ▪ Convector (e.g. heater) 1.5°C 100 min ▪ Free configuration
	Fan coil: <ul style="list-style-type: none"> ▪ Fan coil 4°C 90 min ▪ Free configuration

Multiple heating types (panel heating, convector heating or fan coil) with preset parameters are available to the user.

- If the required heating type is not available, individual parameters can be specified in free configuration.



Note

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.9 Heating control - P-component (x 0.1°C)

Options:	Setting option between 10 - 100
----------	---------------------------------

The P-component refers to the proportional band of a control. It fluctuates around the setpoint value and can be used to influence control speed with a PI controller. The smaller the setpoint, the faster it reacts to the control. However, to avoid the risk of an overshoot, this value should not be set too low. A P-component from 0.1 to 25.5 K can be set.



Note

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Heating type" parameter must be set on "Free configuration".

10.2.10 Heating control - I-component (min.)

Options:	Setting option between 0 - 255
----------	--------------------------------

The I-component refers to the reset time of a control. The integral component has the effect of moving the room temperature slowly toward, and ultimately reaching, the setpoint value. Depending on the type of system used, the reset time has to have different values. In general, the more inactive the overall system, the greater the reset time.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Heating type" parameter must be set on "Free configuration".

10.2.11 Heating control - Extended settings

Options:	No
	Yes

- This parameter enables additional functions and communication objects, e.g. "Basic stage heating".

10.2.12 Basic stage heating

**Note**

Only available when the "Extended settings" parameter under "Heating control" is set on "Yes".

10.2.13 Basic stage heating - Status object heating

Options:	No
	Yes

- This parameter enables the "Status heating" communication object.

10.2.14 Basic stage heating - Mode of the control value

Options:	Normal
	Inverse

The mode of the control value can be used to adapt the control value to de-energised opened (normal) or de-energised closed (inverse) valves.

- *Normal*: Value 0 means "Valve closed".
- *Inverse*: Value 0 means "Valve open".

10.2.15 Basic stage heating - Hysteresis (x 0.1°C)

Options:	Setting option between 3 - 255
----------	--------------------------------

The hysteresis of the two-point controller specifies the fluctuation range of the controller around the setpoint value. The lower switching point is located at "Setpoint value minus hysteresis" and the upper point is at "Setpoint value plus hysteresis".



Note

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On" or "2-point 1 Byte, 0/100%".

10.2.16 Basic stage heating - Control value difference for sending of heating control value

Options:	2 %
	5 %
	10 %
	Send cyclic only

The control values of the 0 - 100% PI continuous controller are not transmitted after every calculation. Instead, they are transmitted when the calculation results in a value that is different enough to the previous sent value to make a transmission meaningful. This value difference can be entered here.



Note

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.17 Basic stage heating - Cyclic sending of the control value (min)

Options:	Setting option between 1 - 60 minutes
----------	---------------------------------------

The current control value used by the device can be cyclically transmitted to the bus.



Note

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On", "2-point 1 Byte, 0/100%", "PI continuous, 0-100%" or "Fan coil".

10.2.18 Basic stage heating - PWM cycle heating (min)

Options:

Setting option between 1 - 60 minutes

In PI PWM, On/off the control value percentage values are converted into a pulse-interval signal. This means that a selected PWM cycle will be divided into an on-phase and an off-phase based on the control value. Accordingly, a control value output of 33% in a PWM cycle of 15 min. results in an "On-phase" of five minutes and an "Off-phase" of 10 min. The time for a PWM cycle can be specified here.

**Note**

This parameter is only available when the "Control value type" parameter is set on "PI PWM, On/Off".

10.2.19 Basic stage heating - Maximum control value (0 - 255)

Options:

Setting option between 0 - 255

The maximum control value of the PI controller defines the maximum value outputted by the controller. If a maximum value under 255 is chosen, the value will not be exceeded, even if the controller calculates a higher control value.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.20 Basic stage heating - Minimum control value for basic load (0 to 255)

Options:

Setting option between 0 - 255

The minimum control value of the PI controller defines the minimum value output by the controller. If a minimum value greater than zero is chosen, the controller will not output a lower value, even if it calculates a value that is lower. This parameter can be used to set a basic load, e.g. for operating floor heating. Even if the controller calculates the control value zero, a heating medium will flow through the floor heating system to prevent the floor from cooling down. Under "Settings of basic load", it is also possible to define whether this basic load will be permanently active or whether it will be switched by the "Basic load" object.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.21 Control of additional heating stage**Note**

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Heating with additional stage" or "Heating and cooling with additional stages".

10.2.22 Control of additional heating stage - Control value type

Options:	2-point 1 bit, Off/On
	2-point 1 byte, (0/100%)
	PI continuous, 0-100%
	PI PWM, On/Off
	Fan coil

The actuation of the control valve is determined by the selection of the controller type.

- *2-Point 1 Bit, Off/On*: The 2-point control is the simplest type of control. The controller switches on when the room temperature drops below a certain level (setpoint temperature value minus hysteresis) and switches off when a particular value (setpoint temperature value plus hysteresis) is exceeded. The switch-on and switch-off commands are transmitted as 1-bit commands.
- *2-Point 1 Byte, 0/100%*: This is another two-point control as described above. In this case, however, the switch-on and switch-off commands are transmitted as 1-byte values (0% / 100%).
- *PI continuous, 0-100%*: The PI controller adjusts its output value between 0% and 100% to match the difference between the actual value and the setpoint value and enables a precise regulation of the room temperature to the setpoint value. It sends the control value to the bus as a 1-byte value (0% - 100%). To reduce the bus load, the control value is only transmitted if it has changed by a predefined percentage in relation to the previous sent value. The control value can also be transmitted cyclically.
- *PI PWM, On/Off*: This also is a PI controller. Here, the output is a 1-bit command. For this to occur, the calculated control value is converted into a pulse-interval signal.
- *Fan coil*: The fan coil controller operates like the PI continuous controller. In addition, it allows the separate activation of the fan in the fan coil unit (e.g. fan speed levels 1 - 3).

10.2.23 Control of additional heating stage - Additional heating type

Options:	PI continuous, 0 – 100% and PI PWM, On/Off:
	<ul style="list-style-type: none"> ▪ Area (e.g. floor heating) 4°C 200 min ▪ Convector (e.g. heater) 1.5°C 100 min ▪ Free configuration
	Fan coil:
	<ul style="list-style-type: none"> ▪ Fan coil 4°C 90 min ▪ Free configuration

Multiple heating types (panel heating, convector heating or fan coil) with preset parameters are available to the user.

- If the required heating type is not available, individual parameters can be specified in free configuration.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.24 Control of additional heating stage - P-component (x 0.1°C)

Options:	Setting option between 10 - 100
----------	---------------------------------

The P-component refers to the proportional band of a control. It fluctuates around the setpoint value and can be used to influence control speed with a PI controller. The smaller the setpoint, the faster it reacts to the control. However, to avoid the risk of an overshoot, this value should not be set too low. A P-component from 0.1 to 25.5 K can be set.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Additional heating type" parameter must be set on "Free configuration".

10.2.25 Control of additional heating stage - P-component (min)

Options:	Setting option between 0 - 255
----------	--------------------------------

The I-component refers to the reset time of a control. The integral component has the effect of moving the room temperature slowly toward, and ultimately reaching, the setpoint value. Depending on the type of system used, the reset time has to have different values. In general, the more inactive the overall system, the greater the reset time.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Additional heating type" parameter must be set on "Free configuration".

10.2.26 Control of additional heating stage - Temperature difference to basic stage (x 0.1°C)

Options:	Setting option between 0 - 255
----------	--------------------------------

The setpoint temperature of the additional stage is defined as a function of the current setpoint temperature of the base stage and is expressed as a difference. The value represents the setpoint value starting at which the additional stage will operate.

10.2.27 Control of additional heating stage - Extended settings

Options:	No
	Yes

This parameter enables additional functions and communication objects, e.g. "Additional heating stage".

10.2.28 Additional heating stage**Note**

Only available when the "Extended settings" parameter under "Control of additional heating stage" is set on "Yes".

10.2.29 Additional heating stage - Mode of the control value

Options:	Normal
	Inverse

The mode of the control value can be used to adapt the control value to de-energised opened (normal) or de-energised closed (inverse) valves.

- *Normal*: Value 0 means "Valve closed".
- *Inverse*: Value 0 means "Valve open".

10.2.30 Additional heating stage - Hysteresis (x 0.1°C)

Options:	Setting option between 3 - 255
----------	--------------------------------

The hysteresis of the two-point controller specifies the fluctuation range of the controller around the setpoint value. The lower switching point is located at "Setpoint value minus hysteresis" and the upper point is at "Setpoint value plus hysteresis".

**Note**

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On" or "2-point 1 Byte, 0/100%".

10.2.31 Additional heating stage - Control value difference for sending of heating control value

Options:	2 %
	5 %
	10 %
	Send cyclic only

The control values of the 0 - 100% PI continuous controller are not transmitted after every calculation. Instead, they are transmitted when the calculation results in a value that is different enough to the previous sent value to make a transmission meaningful. This value difference can be entered here.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.32 Additional heating stage - Cyclic sending of the control value (min)

Options: Setting option between 1 - 60 minutes

The current control value used by the device can be cyclically transmitted to the bus.



Note

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On", "2-point 1 Byte, 0/100%", "PI continuous, 0-100%" or "Fan coil".

Additional heating stage - Maximum control value (0 - 255)

Options: Setting option between 0 - 255

The maximum control value of the PI controller defines the maximum value outputted by the controller. If a maximum value under 255 is chosen, the value will not be exceeded, even if the controller calculates a higher control value.



Note

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.33 Additional heating stage - Minimum control value for basic load (0 - 255)

Options: Setting option between 0 - 255

The minimum control value of the PI controller defines the minimum value output by the controller. If a minimum value greater than zero is chosen, the controller will not output a lower value, even if it calculates a value that is lower. This parameter can be used to set a basic load, e.g. for operating floor heating. Even if the controller calculates the control value zero, a heating medium will flow through the floor heating system to prevent the floor from cooling down. Under "Settings of basic load", it is also possible to define whether this basic load will be permanently active or whether it will be switched by the "Basic load" object.



Note

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.34 Cooling control



Note

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.35 Cooling control - Control value type

Options:	2-point 1 bit, Off/On
	2-point 1 byte, (0/100%)
	PI continuous, 0-100%
	PI PWM, On/Off
	Fan coil

The actuation of the control valve is determined by the selection of the controller type.

- *2-Point 1 Bit, Off/On*: The 2-point control is the simplest type of control. The controller switches on when the room temperature drops below a certain level (setpoint temperature value minus hysteresis) and switches off when a particular value (setpoint temperature value plus hysteresis) is exceeded. The switch-on and switch-off commands are transmitted as 1-bit commands.
- *2-Point 1 Byte, 0/100%*: This is another two-point control as described above. In this case, however, the switch-on and switch-off commands are transmitted as 1-byte values (0% / 100%).
- *PI continuous, 0-100%*: The PI controller adjusts its output value between 0% and 100% to match the difference between the actual value and the setpoint value and enables a precise regulation of the room temperature to the setpoint value. It sends the control value to the bus as a 1-byte value (0% - 100%). To reduce the bus load, the control value is only transmitted if it has changed by a predefined percentage in relation to the previous sent value. The control value can also be transmitted cyclically.
- *PI PWM, On/Off*: This also is a PI controller. Here, the output is a 1-bit command. For this to occur, the calculated control value is converted into a pulse-interval signal.
- *Fan coil*: The fan coil controller operates like the PI continuous controller. In addition, it allows the separate activation of the fan in the fan coil unit (e.g. fan speed levels 1 - 3).

10.2.36 Cooling control - Cooling type

Options:	PI continuous, 0 – 100% and PI PWM, On/Off: <ul style="list-style-type: none"> ▪ Area (e.g. cooling ceiling) 5°C 240 min ▪ Free configuration
	Fan coil: <ul style="list-style-type: none"> ▪ Fan coil 4°C 90 min ▪ Free configuration

Two cooling types (area or fan coil) with preset parameters are available to the user.

If the required cooling type is not available, individual parameters can be specified in free configuration.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.37 Cooling control - P-component (x 0.1°C)

Options:	Setting option between 10 - 100
----------	---------------------------------

The P-component refers to the proportional band of a control. It fluctuates around the setpoint value and can be used to influence control speed with a PI controller. The smaller the setpoint, the faster it reacts to the control. However, to avoid the risk of an overshoot, this value should not be set too low. A P-component from 0.1 to 25.5 K can be set.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Cooling type" parameter must be set on "Free configuration".

10.2.38 Cooling control - I-component (min.)

Options:	Setting option between 0 - 255
----------	--------------------------------

The I-component refers to the reset time of a control. The integral component has the effect of moving the room temperature slowly toward, and ultimately reaching, the setpoint value. Depending on the type of system used, the reset time has to have different values. In general, the more inactive the overall system, the greater the reset time.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Cooling type" parameter must be set on "Free configuration".

10.2.39 Cooling control - Extended settings

Options:	No
	Yes

This parameter enables additional functions and communication objects, e.g. "Basic stage cooling".

10.2.40 Basic stage cooling

**Note**

Only available when the "Extended settings" parameter under "Cooling control" is set on "Yes".

10.2.41 Basic stage cooling - Status object cooling

Options:	No
	Yes

This parameter enables the "Status cooling" communication object.

10.2.42 Basic stage cooling - Mode of the control value

Options:	Normal
	Inverse

The mode of the control value can be used to adapt the control value to de-energised opened (normal) or de-energised closed (inverse) valves.

- *Normal*: Value 0 means "Valve closed".
- *Inverse*: Value 0 means "Valve open".

10.2.43 Basic stage cooling - Hysteresis (x 0.1°C)

Options:	Setting option between 3 - 255
----------	--------------------------------

The hysteresis of the two-point controller specifies the fluctuation range of the controller around the setpoint value. The lower switching point is located at "Setpoint value minus hysteresis" and the upper point is at "Setpoint value plus hysteresis".

**Note**

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On" or "2-point 1 Byte, 0/100%".

Basic stage cooling - Control value difference for sending of cooling control value

Options:	2 %
	5 %
	10 %
	Send cyclic only

The control values of the 0 - 100% PI continuous controller are not transmitted after every calculation. Instead, they are transmitted when the calculation results in a value that is different enough to the previous sent value to make a transmission meaningful. This value difference can be entered here.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.44 Basic stage cooling - Cyclic sending of the control value (min)

Options:	Setting option between 1 - 60 minutes
----------	---------------------------------------

The current control value used by the device can be cyclically transmitted to the bus.

**Note**

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On", "2-point 1 Byte, 0/100%", "PI continuous, 0-100%" or "Fan coil".

10.2.45 Basic stage cooling

**Note**

Only available when the "Extended settings" parameter under "Cooling control" is set on "Yes".

10.2.46 Basic stage cooling - Maximum control value (0 - 255)

Options:

Setting option between 0 - 255

The maximum control value of the PI controller defines the maximum value outputted by the controller. If a maximum value under 255 is chosen, the value will not be exceeded, even if the controller calculates a higher control value.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.47 Basic stage cooling - Minimum control value for basic load (0 to 255)

Options:

Setting option between 0 - 255

The minimum control value of the PI controller defines the minimum value output by the controller. If a minimum value greater than zero is chosen, the controller will not output a lower value, even if it calculates a value that is lower. This parameter can be used to set a basic load, e.g. for operating surface cooling. Even if the controller calculates the control value zero, a cooling medium will flow through the cooling area to prevent the floor from heating up. Under "Settings of basic load", it is also possible to define whether this basic load will be permanently active or whether it will be switched by the "Basic load" object.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.48 Control of additional cooling stage

**Note**

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Cooling with additional stage" or "Heating and cooling with additional stages".

Options:	2-point 1 bit, Off/On
	2-point 1 byte, (0/100%)
	PI continuous, 0-100%
	PI PWM, On/Off
	Fan coil

The actuation of the control valve is determined by the selection of the controller type.

- *2-Point 1 Bit, Off/On*: The 2-point control is the simplest type of control. The controller switches on when the room temperature drops below a certain level (setpoint temperature value minus hysteresis) and switches off when a particular value (setpoint temperature value plus hysteresis) is exceeded. The switch-on and switch-off commands are transmitted as 1-bit commands.
- *2-Point 1 Byte, 0/100%*: This is another two-point control as described above. In this case, however, the switch-on and switch-off commands are transmitted as 1-byte values (0% / 100%).
- *PI continuous, 0-100%*: The PI controller adjusts its output value between 0% and 100% to match the difference between the actual value and the setpoint value and enables a precise regulation of the room temperature to the setpoint value. It sends the control value to the bus as a 1-byte value (0% - 100%). To reduce the bus load, the control value is only transmitted if it has changed by a predefined percentage in relation to the previous sent value. The control value can also be transmitted cyclically.
- *PI PWM, On/Off*: This also is a PI controller. Here, the output is a 1-bit command. For this to occur, the calculated control value is converted into a pulse-interval signal.
- *Fan coil*: The fan coil controller operates like the PI continuous controller. In addition, it allows the separate activation of the fan in the fan coil unit (e.g. fan speed levels 1 - 3).

10.2.49 Control of additional cooling stage - Cooling type

Options:	PI continuous, 0 – 100% and PI PWM, On/Off: <ul style="list-style-type: none"> ▪ Area (e.g. cooling ceiling) 5°C 240 min ▪ Free configuration
	Fan coil: <ul style="list-style-type: none"> ▪ Fan coil 4°C 90 min ▪ Free configuration

Two cooling types (area or fan coil) with preset parameters are available to the user.

If the required cooling type is not available, individual parameters can be specified in free configuration.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.50 Control of additional cooling stage - P-component (x 0.1°C)

Options:	Setting option between 10 - 100
----------	---------------------------------

The P-component refers to the proportional band of a control. It fluctuates around the setpoint value and can be used to influence control speed with a PI controller. The smaller the setpoint, the faster it reacts to the control. However, to avoid the risk of an overshoot, this value should not be set too low. A P-component from 0.1 to 25.5 K can be set.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Cooling type" parameter must be set on "Free configuration".

10.2.51 Control of additional cooling stage - P-component (min)

Options:	Setting option between 0 - 255
----------	--------------------------------

The I-component refers to the reset time of a control. The integral component has the effect of moving the room temperature slowly toward, and to ultimately reaching, the setpoint. Depending on the type of system used, the reset time has to have different values. In general, the more inactive the overall system, the greater the reset time.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil". In addition, the "Cooling type" parameter must be set on "Free configuration".

10.2.52 Control of additional cooling stage - Extended settings

Options:	No
	Yes

This parameter enables additional functions and communication objects, e.g. "Additional cooling stage".

10.2.53 Additional cooling stage**Note**

Only available when the "Extended settings" parameter under "Control of additional cooling stage" is set on "Yes".

10.2.54 Additional cooling stage - Mode of the control value

Options:	Normal
	Inverse

The mode of the control value can be used to adapt the control value to de-energised opened (normal) or de-energised closed (inverse) valves.

- *Normal*: Value 0 means "Valve closed".
- *Inverse*: Value 0 means "Valve open".

10.2.55 Additional cooling stage - Hysteresis (x 0.1°C)

Options:	Setting option between 3 - 255
----------	--------------------------------

The hysteresis of the two-point controller specifies the fluctuation range of the controller around the setpoint value. The lower switching point is located at "Setpoint value minus hysteresis" and the upper point is at "Setpoint value plus hysteresis".

**Note**

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On" or "2-point 1 Byte, 0/100%".

10.2.56 Additional cooling stage - Control value difference for sending of cooling control value

Options:	2%
	5%
	10%

The control values of the 0 - 100% PI continuous controller are not transmitted after every calculation. Instead, they are transmitted when the calculation results in a value that is different enough to the previous sent value to make a transmission meaningful. This value difference can be entered here.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.57 Additional cooling stage - Cyclic sending of the control value (min)

Options:	Setting option between 1 - 60 minutes
----------	---------------------------------------

The current control value used by the device can be cyclically transmitted to the bus.

**Note**

This parameter is only available when the "Control value type" parameter is set either on "2-point 1 Bit, Off/On", "2-point 1 Byte, 0/100%", "PI continuous, 0-100%" or "Fan coil".

10.2.58 Additional cooling stage - Maximum control value (0 - 255)

Options:	Setting option between 0 - 255
----------	--------------------------------

The maximum control value of the PI controller defines the maximum value outputted by the controller. If a maximum value under 255 is chosen, the value will not be exceeded, even if the controller calculates a higher control value.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.59 Additional cooling stage - Minimum control value for basic load (0 - 255)

Options:	Setting option between 0 - 255
----------	--------------------------------

The minimum control value of the PI controller defines the minimum value output by the controller. If a minimum value greater than zero is chosen, the controller will not output a lower value, even if it calculates a value that is lower. This parameter can be used to set a basic load, e.g. for operating surface cooling. Even if the controller calculates the control value zero, a cooling medium will flow through the cooling area to prevent the floor from heating up. Under "Settings of basic load", it is also possible to define whether this basic load will be permanently active or whether it will be switched by the "Basic load" object.

**Note**

This parameter is only available when "Control value type" parameter is set either on "PI continuous, 0 – 100%", "PI PWM, On/Off" or "Fan coil".

10.2.60 Settings of basic load**Note**

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Heating with additional stage", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.61 Settings of basic load - Minimum control value for basic load > 0

Options:	Always active
	Activate via object

The function finds application when in the desired area, e.g. with floor heating, the floor is to have a basic warmth. The size of the minimum control value specifies the volume of heating medium that flows through the controlled area, even when the calculation of the control value of the controller would indicate a lower value.

- *Always active*: Here it is possible to define whether this basic load will be permanently active or whether it will be switched via the "Basic load" object.
- *Activate via object*: When this parameter is selected, the basic load function, which means the minimum control value with a value higher than zero, can be activated (1) or deactivated (2). If it is activated, then the heating medium will always be fed through the system with at least the minimum control value. If it is deactivated, the control value can be reduced to zero with the controller.

10.2.62 Combined heating and cooling modes**Note**

Only available when the "Device function" parameter is set on either "Single device" or "Master device" and the control function parameter is set on either "Heating and cooling" or "Heating and cooling with additional stages".

10.2.63 Combined heating and cooling modes - Switchover of heating/cooling

Options:	Automatic
	Only via object
	On-site/via extension unit and via object

This function makes it possible to switch between the heating and cooling mode of the device.

- *Automatic*: E.g. for four-conductor systems which allow the switchover between heating and cooling at all times. The device switches automatically between heating and cooling and to the associated setpoint. "Switchover heating/cooling" is a transmitting object.
- *Only via object*: E.g. for two-conductor systems which are operated in heating mode in the winter and cooling mode in the summer. The switchover between heating and cooling and to the associated setpoint is carried out via the corresponding communication object. This function is used when a central switchover of the single room controllers is required. "Switchover heating/cooling" is a receiving object.
- *Local/ via extension unit and via object*: E.g. for four-conductor systems which allow the switchover between heating and cooling at all times. The switchover between heating and cooling and to the associated setpoint is carried out manually on the device by the user of the room or via the "Switchover heating/cooling" object via the bus. "Switchover heating/cooling" is a transmitting and receiving object.

10.2.64 Combined heating and cooling modes - Operating mode after reset

Options:	Cooling
	Heating

After a bus voltage failure, a system reset, or the attachment of a device to the bus coupler, the device starts in the parameterized "Operating mode after reset". The operating mode can be changed when the system is running using the options set under "Switchover heating/cooling".

10.2.65 Combined heating and cooling modes - Heating/cooling control value output

Options:	Via 1 object
	Via 2 objects

This parameter is used to define whether the control value is transmitted to the climate control actuator using one or two objects. If the climate control actuator has separate control value inputs for heating and cooling, or if separate actuators are used, then the option "Via 2 objects" must be selected. Select the option "Via 1 object" if a single actuator only has one object that receives both the heating and the cooling control values.

10.2.66 Combined heating and cooling modes - Additional heating/cooling stage control value output

Options:	Via 1 object
	Via 2 objects

This parameter is used to define whether the control value is transmitted to the climate control actuator using one or two objects. If the climate control actuator has separate control value inputs for heating and cooling, or if separate actuators are used, then the option "Via 2 objects" must be selected. Select the option "Via 1 object" if a single actuator only has one object that receives both the heating and the cooling control values.



Note

This parameter is only available when the "Control function" parameter is set on "Heating and cooling with additional stages".

10.2.67 Setpoint settings



Note

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device".

10.2.68 Setpoint settings - Setpoint for heating comfort = setpoint for cooling comfort

Options:	No
	Yes

This parameter is used to configure the manner in which the setpoint adjustment functions.

- **Yes:** The device has the same setpoint for heating and cooling in the comfort mode. The system switches to heating when the temperature drops below the setpoint minus hysteresis. It switches to cooling when the temperature exceeds the setpoint plus hysteresis. The hysteresis is parameterizable.
- **No:** The function has two separate setpoints for heating and cooling in the comfort mode. The device will display the currently active setpoint value. Switching between heating and cooling occurs via the "Switchover heating/cooling" parameter setting.



Note

This parameter is only available when the "Control function" parameter is set on "Heating and cooling" or "heating and cooling with additional stages".

10.2.69 Setpoint settings - Hysteresis for switchover heating/cooling (x 0.1°C)

Options: Setting option between 5 - 100

This parameter specifies the one-sided hysteresis for switching between heating and cooling when "Setpoint heating comfort = Setpoint cooling comfort" is active. If the room temperature exceeds the setpoint temperature value plus hysteresis, the system switches to cooling. If the room temperature falls below the setpoint temperature value minus hysteresis, the system switches to heating.



Note

This parameter is only available when the "Setpoint heating comfort = Setpoint cooling comfort" parameter is set on "Yes".

10.2.70 Setpoint settings - Setpoint temperature for heating and cooling comfort (°C)

Options: Setting option between 10 - 40

Specifies the comfort temperature for heating and cooling when people are present.



Note

This parameter is only available when the "Control function" parameter is set on "Heating and cooling" or "heating and cooling with additional stages".

10.2.71 Setpoint settings - Setpoint temperature for heating comfort (°C)

Options: Setting option between 10 - 40

Specifies the comfort temperature for heating when people are present.



Note

This parameter is only available when the "Control function" parameter is set on "Heating" or "Heating with additional stage".

10.2.72 Setpoint settings - Reduction for standby heating (°C)

Options: Setting option between 10 - 40

Specifies the temperature in heating mode when nobody is present. On devices with a display, this mode is indicated by the standby icon.



Note

This parameter is only available when the "Control function" parameter is set on "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.73 Setpoint settings - Reduction for ECO heating (°C)

Options: Setting option between 0 - 15

Specifies the temperature in heating mode when nobody is present. On devices with a display, this mode is indicated by the eco icon.

10.2.74 Setpoint settings - Set-point temperature for frost protection (°C)

Options: Setting option between 5 - 15

Function for protecting the building against the cold. On devices with a display, this mode is indicated by the frost protection icon. Manual operation is blocked.



Note

This parameter is only available when the "Control function" parameter is set on "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.75 Setpoint settings - Setpoint temperature for cooling comfort (°C)

Options: Setting option between 10 - 40

Specifies the comfort temperature for cooling when people are present.



Note

This parameter is only available when the "Control function" parameter is set on "Cooling" or "Cooling with additional stage".

10.2.76 Setpoint settings - Increase for standby cooling (°C)

Options: Setting option between 0 - 15

Specifies the temperature in cooling mode when nobody is present. On devices with a display, this mode is indicated by the standby icon.



Note

This parameter is only available when the "Control function" parameter is set on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.77 Setpoint settings - Increase for ECO cooling (°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

Specifies the temperature in cooling mode when nobody is present. On devices with a display, this mode is indicated by the eco icon.

**Note**

This parameter is only available when the "Control function" parameter is set on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.78 Setpoint settings - Set-point temperature for heat protection (°C)

Options:	Setting option between 27 - 45
----------	--------------------------------

Function for protecting the building against heat. On devices with a display, this mode is indicated by the heat protection icon. Manual operation is blocked.

**Note**

This parameter is only available when the "Control function" parameter is set on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.79 Setpoint settings - Display indicates

Options:	Current setpoint
	Relative setpoint

The display can indicate either the absolute or relative setpoint value.

- *Current setpoint*: On devices with a display, the setpoint is shown as an absolute temperature, e.g. 21.0°C.
- *Relative setpoint*: On devices with display, the setpoint is indicated as a relative value, e.g. - 5°C .. + 5°C.

10.2.80 Setpoint settings - Display indicates

Options:	Current setpoint
	Relative setpoint

The display can indicate either the absolute or relative setpoint value.

- *Current setpoint*: On devices with a display, the setpoint is shown as an absolute temperature, e.g. 21.0°C.
- *Relative setpoint*: On devices with display, the setpoint is indicated as a relative value, e.g. - 5°C .. + 5°C.

10.2.81 Setpoint settings - Send current setpoint

Options:	Cyclic and during change
	Only for change

The current setpoint value can be sent to the bus either cyclically and after a change, or only after a change.

10.2.82 Setpoint settings - Cyclic sending of the current set-point temperature (min)

Options:	Setting option between 5 - 240
----------	--------------------------------

This parameter is used to specify the amount of time that will elapse before the current setpoint value is automatically transmitted.

**Note**

This parameter is only available when the "Send current setpoint" is set on "Only during change".

10.2.83 Setpoint adjustment**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device".

10.2.84 Setpoint adjustment — Maximum manual increase during heating mode (0 - 15°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

This preset can be used to limit the manual increase during heating.

**Note**

This parameter is only available when the "Control function" parameter is set on "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.85 Setpoint adjustment — Maximum manual reduction during heating mode (0 - 15°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

This preset can be used to limit the manual decrease during heating.

**Note**

This parameter is only available when the "Control function" parameter is set on "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.86 Setpoint adjustment — Maximum manual increase during cooling mode (0 - 15°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

This preset can be used to limit the manual increase during cooling.

**Note**

This parameter is only available when the "Control function" parameter is set on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.87 Setpoint adjustment — Maximum manual reduction during cooling mode (0 - 15°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

This preset can be used to limit the manual decrease during cooling.

**Note**

This parameter is only available when the "Control function" parameter is set on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.88 Setpoint adjustment - Resetting of the manual adjustment for receipt of a basic setpoint

Options:	No
	Yes

Activating this parameter will cause the manual adjustment to be deleted and the new setpoint value to be provided when a new value is received via the "Basic setpoint" object.

If the parameter is deactivated, the manual adjustment is added to the new base setpoint value. Example: Previous base setpoint value of 21°C + manual adjustment of 1.5°C = 22.5°C. The object receives a new basic setpoint of 18°C plus the previous manual adjustment of 1.5°C for a total of 19.5°C.

10.2.89 Setpoint adjustment - Resetting the manual adjustment for change of operating mode

Options:	No
	Yes

If the device switches to a new operating mode, the manual adjustment is deleted and the parameterized setpoint temperature for the operating mode plus any change by the base setpoint value object will be applied if this parameter is activated. Example: Comfort temperature of 21°C plus manual adjustment of 1.5°C = 22.5°C. Change to Eco with programmed temperature 17°C. The device regulates the temperature to 17°C, since the manual adjustment is deleted.

If the parameter is deactivated, the manual setpoint adjustment will be added to the temperature in the new operating mode. Example: Comfort temperature of 21°C plus manual adjustment of 1.5°C = 22.5°C. If the system switches to Eco with a parameterized temperature of 17°C, the device regulates the temperature to 18.5°C, since the manual adjustment is added.

10.2.90 Setpoint adjustment - Resetting the manual adjustment via object

Options:	No
	Yes

If this parameter is activated, a separate object can be used to delete the manual adjustment at any time. Example of application: Resetting the manual adjustment on all devices located in a building using a system clock.

10.2.91 Setpoint adjustment - Permanent storage of on-site operation

Options:	No
	Yes

If this parameter is activated, the manual settings for setpoint and, where applicable, fan speed level, as well as the value of the "Basic load" object, will be stored in the device and re-activated after a reset. If the device is re-programmed, the stored setpoint values will also be deleted.

10.2.92 Temperature reading - Inputs of temperature reading

Options:	Internal measurement
	External measurement
	Weighted measurement

The room temperature can be measured at the device or fed to the device by an object via the bus. In addition, weighted measuring is also available, in which the weighted average of up to three temperature values (1 x internal, 2 x external) is calculated and used as an input value for control.

10.2.93 Temperature reading - Inputs of weighted temperature reading

Options:	Internal and external measurement
	2 x external measurement
	Internal and 2x external measurement

Specifies the temperature reading inputs for the weighted measurement, in which the calculated weighted average of the inputs is used as an input value for control

**Note**

This parameter is only available when the "Inputs of temperature reading" parameter is set on "Weighted measurement".

10.2.94 Temperature reading - Weighting of internal measurement (0 to 100%)

Options:	Setting option between 0 - 15
----------	-------------------------------

Specifies the weighting of the internal measurement at a level between 0% and 100%.

**Note**

This parameter is only available when the "Inputs of weighted temperature reading" parameter is set on "Internal and external measurement" or "Internal and 2x external measurement".

10.2.95 Temperature reading - Weighting of external measurement (0 to 100%)

Options:	Setting option between 0 - 15
----------	-------------------------------

Specifies the weighting of the external measurement at a level between 0% and 100%.

**Note**

This parameter is only available when the "Inputs of weighted temperature reading" parameter is set on "Internal and external measurement", "2x external measurement" or "Internal and 2x external measurement".

10.2.96 Temperature reading - Weighting of external measurement 2 (0 to 100%)

Options:	Setting option between 0 - 15
----------	-------------------------------

Specifies the weighting of the external measurement 2 at a level between 0% and 100%. When added together with the (0%...100%) weighting of the external measurement, the result must be 100%.

**Note**

This parameter is only available when the "Inputs of weighted temperature reading" parameter is set on "2x external measurement" or "Internal and 2x external measurement".

10.2.97 Temperature reading - Cyclic sending of the actual temperature (min)

Options:

Setting option between 5 - 240

The current actual temperature used by the device can be cyclically transmitted to the bus.

10.2.98 Temperature reading - Difference of value for sending the actual temperature (x 0.1°C)

Options:

Setting option between 1 - 100

If the change in temperature exceeds the parameterized difference between the measured actual temperature and the previous actual temperature that was sent, the changed value will be transmitted.

10.2.99 Temperature reading - Adjustment value for internal temperature measurement (x 0.1°C)

Options:

Setting option between 1 - 100

Every installation location has different physical conditions (interior or exterior wall, lightweight or solid wall, etc.). In order to use the actual temperature at the installation location as a measured value for the device, a temperature measurement must be performed by an external equalised and / or calibrated thermometer at the installation location. The difference between the actual temperature displayed on the device and the actual temperature determined by the external measurement device must be entered in the parameter field as an "Adjustment value".

**Note**

- The calibration measurement should not be carried out immediately after the device has been installed. The device should first adjust to the ambient temperature before calibration is carried out. The calibration measurement should be repeated shortly before or after the room is occupied.
- This parameter is only available when the "Inputs of temperature reading" parameter is set on "Internal measurement" or "Weighted measurement".

10.2.100 Temperature reading - Monitoring time for temperature reading (0 = no monitoring) (min)

Options:

Setting option between 0 - 120

If no temperature is read within the parameterized time period, the device switches to error mode. It transmits a telegram to the bus via the "Actual temperature error" object and applies the operating mode and control value for error (0 - 255) settings.

10.2.101 Temperature reading — Operating mode for fault

Options:	Cooling
	Heating

In the event of a failure of the actual temperature measurement, the device will no longer be able to independently specify the heating/cooling operating type. As a result, the operating type best suited to protecting the building will be selected.

**Note**

This parameter is only available when the "Control function" parameter is set on "Heating and cooling" or "heating and cooling with additional stages".

10.2.102 Temperature reading - Control value for fault (0 - 255)

Options:	Setting option between 0 - 255
----------	--------------------------------

In the event of a failure of the actual temperature measurement, the device will no longer be able to independently determine the control value. Therefore, a control value which is suitable for protecting the building will be selected.

10.2.103 Alarm functions**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device".

10.2.104 Alarm functions - Condensate water alarm

Options:	No
	Yes

If a fan coil is used, condensation may form during operation as a result of excessive cooling and/or humidity. The associated condensate is typically collected in a container. To protect the container against overflowing, and thus prevent potential damage to devices and/or the building, the container alerts the "Condensation alarm" object (receiving only) that the maximum fill level has been exceeded. This causes the controller to switch to a protective mode. This status is indicated by the corresponding icon on devices that have a display. Local operation is blocked. Operation is only possible again after the alarm has been deactivated.

**Note**

This parameter is only available when the "Control function" parameter is set either on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.105 Alarm functions — Dew point alarm

Options:	No
	Yes

When refrigerating machines are used, dew may appear on the refrigerant supply lines during operation as a result of excessive cooling and/or humidity. The dew indicator reports the dew formation via the "Dew point alarm" object (receiving only). This causes the controller to switch to a protective mode. This status is indicated by the corresponding icon on devices that have a display. Local operation is blocked. Operation is only possible again after the alarm has been deactivated.

**Note**

This parameter is only available when the "Control function" parameter is set either on "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.106 Alarm functions - Frost alarm temperature for HVAC and RHCC status (°C)

Options:	Setting option between 0 - 15
----------	-------------------------------

The RHCC status and HVAC objects have a frost alarm bit. If the input temperature of the controller drops below the temperature set in this parameter, then the frost alarm bit is set in the status objects. It is reset when the temperature is exceeded.

10.2.107 Alarm functions - Heat alarm temperature for RHCC status (°C)

Options:	Setting option between 25 - 70
----------	--------------------------------

The RHCC status object has a heat alarm bit. If the input temperature of the controller exceeds the temperature set in this parameter, then the heat alarm bit is set in the status object. It is reset when the temperature falls below the set temperature.

10.2.108 Fan coil settings - Fan speed levels**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device" and the "Control value type" parameter is set on "Fan coil".

10.2.109 Fan coil settings - Fan speed levels Number of fan speed levels

Options:	3 levels
	5 levels

This parameter is used to specify the number of fan speed levels the actuator will use to control the fan of the fan coil.

10.2.110 Fan coil settings - Fan speed levels - Format of the level output

Options:	0..5
	0..255
	1 bit m off n
	1 bit m 1 off n

- *0 to 5*: The level values (0..3 or 0..5) are output in the 1-byte format as the counter values 0..3 or 0..5.
- *0 to 255*: The level values (0..3 or 0..5) are output as percentage values. Example 5-stage fan: The level value 1 is output as 20%, and 5 is output as 100%.
- *1 Bit m from n*: The level values (0..3 or 0..5) are output using 1-bit objects. The number of objects available is the same as the number of fan speed levels. For level 2, for example, the 1-bit fan speed level objects 1 and 2 are output as the value 1, while the other fan speed level objects use the value 0.
- *1 Bit 1 from n*: The level values (0..3 or 0..5) are output using 1-bit objects. The number of objects available is the same as the number of fan speed levels. For the level 2, for example, only the 1-bit fan speed level object 2 is output as the value 1. The other fan speed level objects use the value 0.

10.2.111 Fan coil settings - Fan speed levels - Level output

Options:	For manual operation and automatic
	Only for manual operation

This parameter is used to specify when the output of the fan speed level values will occur: either only when the fan speed levels are manually adjusted or also in automatic mode. This setting depends on the options for the fan coil actuator. If the actuator itself controls the fan speed levels in automatic mode based on a derivative of the control value, than the "Only for manual operation" option must be selected. Otherwise, the other option should be selected.

10.2.112 Fan coil settings - Fan speed levels - Lowest manually adjustable level

Options:	Level 0
	Level 1

This parameter is used to preselect the lowest fan speed level that can be set by an operation performed at the device. When level 0 is selected, the heating/cooling system will not be in operation (fan speed level and valve control 0) as long as the current operating mode and operation type are maintained. To avoid damage to the building, level 0 is deactivated after 18 hours and the device is returned to automatic mode.

10.2.113 Fan coil settings - Fan speed levels - Level status evaluation

Options:	No
	Yes

The controller obtains the current fan speed level for controlling a fan coil actuator either by calculating it from the table of level values under "Fan coil settings for heating" or "Fan coil settings for cooling", or by receiving feedback from the fan coil actuator. If the "Yes" option is selected, the "Fan coil step status" object is activated for receiving the fan speed level from the fan coil actuator.

10.2.114 Fan coil settings heating**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device" and the "Control value type" parameter is set on "Fan coil". In addition, the "Control function" parameter must be set on either "Heating", "Heating with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.115 Fan coil settings for heating - Speed level 1 to 5 up to control value (0 to 255) heating

Options:	Setting option between 0 - 255
----------	--------------------------------

In this parameter, the control values of the controller are assigned to fan speed levels. This assignment is used if the fan speed levels are transmitted together with the control values.

**Note**

- These level settings should be adjusted to match the settings in the fan coil actuator.
- Setting the "Control value type" to "Fan coil" in the control parameters is only useful for one of either the basic stage or the additional stage. Setting the basic and additional stage parameters to fan coil is not useful, since the control of only one fan coil actuator each for heating and cooling is supported.
- The "Fan speed level 4 - 5 up to control value (0 - 255) heating" parameters are available only when the "Number of fan speed levels" is set on "5 levels".

10.2.116 Fan coil settings for heating - Fan speed level limit heating for eco mode

Options:	No
	Yes

This parameter limits the fan speed level when the system is switched to eco mode.

10.2.117 Fan coil settings for heating - Maximum speed level heating for eco mode

Options:	Setting option between 0 - 5
----------	------------------------------

Specifies the maximum possible fan speed level when the system is switched to eco mode.

10.2.118 Fan coil settings for cooling**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device" and the "Control value type" parameter is set on "Fan coil". In addition, the "Control function" parameter must be set on either "Cooling", "Cooling with additional stage", "Heating and cooling" or "Heating and cooling with additional stages".

10.2.119 Fan coil settings for cooling - Speed level 1 to 5 up to control value (0 to 255) cooling

Options:	Setting option between 0 - 255
----------	--------------------------------

In this parameter, the control values of the controller are assigned to fan speed levels. This assignment is used if the fan speed levels are transmitted together with the control values.

**Note**

- These level settings should be adjusted to match the settings in the fan coil actuator.
- Setting the "Control value type" to "Fan coil" in the control parameters is only useful for one of either the basic stage or the additional stage. Setting the basic and additional stage parameters to fan coil is not useful, since the control of only one fan coil actuator each for heating and cooling is supported.
- The "Fan speed level 4 - 5 up to control value (0 - 255) cooling" parameters are available only when the "Number of fan speed levels" is set on "5 levels".

10.2.120 Fan coil settings for cooling - Fan speed level limit cooling for eco mode

Options:	No
	Yes

This parameter limits the fan speed level when the system is switched to eco mode.

10.2.121 Fan coil settings for cooling - Maximum fan speed level cooling for eco mode

Options:	Setting option between 0 - 5
----------	------------------------------

Specifies the maximum possible fan speed level when the system is switched to eco mode.

10.2.122 Summer compensation**Note**

This parameter is only available if the "Device function" parameter is set on either "Single device" or "Master device".

10.2.123 Summer compensation - Summer compensation

Options:	No
	Yes

In order to save energy, and to ensure that the temperature difference occurring during entry and exit of a climate-controlled building stays within comfortable limits, the excessive reduction of room temperature should be prevented during high temperatures in the summer (Summer compensation according to DIN 1946). The room temperature is increased by adjusting the setpoint temperature for cooling.

Raising the room temperature does not, however, mean that you heat up the room. Rather, the adjustment is intended to allow the room temperature to increase to a certain setpoint without cooling. This, for example, prevents the air-conditioning system from further reducing the room temperature to 24°C with an external temperature of 35°C.

However, activation of the summer compensation requires an outside temperature sensor that transmits its measured value to the bus and can be evaluated by the room temperature controller.

The following parameters are available for summer compensation:

- "Lower outside temperature value for summer compensation",
- "Upper outside temperature value for summer compensation",
- "Lower setpoint offset for summer compensation",
- "Upper setpoint offset for summer compensation"

Above the "Upper outside temperature value", the minimum setpoint temperature for cooling is the outside temperature minus the "Upper setpoint offset". The outside temperature has no effect on the minimum setpoint temperature for cooling below the "Lower outside temperature value". Between the "Lower" and "Upper outside temperature value", the minimum setpoint temperature for cooling undergoes floating adjustment by the parameterized setpoint temperature equal to the outside temperature minus the "Lower offset" to a value equal to the outside temperature minus the "Upper setpoint offset" as a function of the outside temperature.

Typical values for summer compensation are:

- 21°C: Lower outside temperature value
- 32°C: Upper outside temperature value
- 0 K: Lower setpoint offset
- 6 K: Upper setpoint offset

This means that a continuous increase of the minimum setpoint value for cooling occurs to a value equal to the outside temperature minus a setpoint offset of 0 to 6 K if the outside temperature increases to 32°C from 21°C.

For example:

For an increasing outside temperature, the minimum setpoint value for cooling will be increased starting at an outside temperature of 21°C. The minimum setpoint temperature for cooling is 25.1°C at an outside temperature of 30°C; 25.5°C at an outside temperature of 31°C; 26°C at an outside temperature of 32°C; and 27°C at an outside temperature of 33°C.

10.2.124 Summer compensation - (Lower) Starting temperature for summer compensation (°C)

Options:

Setting option between -127 - 127

The parameter defines the lower outside temperature value up to which temperature value the setpoint correction (summer compensation) is performed based on too high an outside temperature.

**Note**

This parameter is only available if the "Summer compensation" parameter is set to "Yes".

10.2.125 Summer compensation - Offset of the set-point temperature for the entry into summer compensation (x 0.1°C)

Options:

Setting option between -127 - 127

The parameter is used to define how many degrees Kelvin the setpoint value will be increased by during summer compensation when the lower temperature value is reached.

Typical values for summer compensation are:

- 20°C: Lower outside temperature value
- 32°C: Upper outside temperature value
- 0 K: Lower setpoint offset
- 4 K: Upper setpoint offset

That means that a flowing setpoint increase of 0 to 4 K occurs if the outside temperature increases from 20°C to 32°C.

**Note**

This parameter is only available if the "Summer compensation" parameter is set to "Yes".

10.2.126 Summer compensation - (Upper) exit temperature for summer compensation (°C)

Options:

Setting option between -127 - 127

The parameter defines the upper outside temperature value up to which temperature value the setpoint correction (summer compensation) is performed based on too high an outside temperature.

**Note**

This parameter is only available if the "Summer compensation" parameter is set to "Yes".

10.2.127 Summer compensation - Offset of the set-point temperature for the exit from summer compensation (x 0.1°C)

Options:

Setting option between -127 - 127

The parameter is used to define how many degrees Kelvin the setpoint value will be increased by during summer compensation when the upper temperature value is reached.

Typical values for summer compensation are:

- 20°C: Lower outside temperature value
- 32°C: Upper outside temperature value
- 0 K: Lower setpoint offset
- 4 K: Upper setpoint offset

That means that a flowing setpoint increase of 0 to 4 K occurs if the outside temperature increases from 20°C to 32°C.



Note

This parameter is only available if the "Summer compensation" parameter is set to "Yes".

10.3 Additional RTC application "Control settings"

10.3.1 General – Jump-back to the primary function

Options:	5 s
	10 s
	20 s
	30 s
	1 min.
	2 min.
	3 min.

The parameter is used to specify the time period of non-operation after which there is a jump-back to the first function of the control element.

10.3.2 Temperature display – Temperature unit

Options:	°C
	°F

This is where the temperature unit is selected for the display on the device. The parameter is used to choose between Celsius (°C) and Fahrenheit (°F).

10.3.3 General - Setting the temperature unit via object

Options:	No
	Yes

The parameter is used to define whether the temperature unit adjustment is transmitted via an object.

10.3.4 General - Setpoint display

Options:	Absolute setpoint (e.g. 21°C)
	Relative setpoint (e.g. -5°C to +5°C)

The parameter is used to define whether the absolute or the relative setpoint is displayed.

10.3.5 General - Display of actual temperature

Options:	No
	Yes

If the actual temperature is to be shown on the display, the parameter must be set on active. The device will then primarily display the actual temperature. When actuating the control element the display changes to the setpoint adjustment. After non-actuation of the control element the current actual temperature again appears in the display after the set waiting period.

10.3.6 General - Waiting period for display of actual temperature

Options:	5 s
	10 s
	20 s
	30 s
	1 min.
	2 min.
	4 min.

After non-actuation of the control element the current actual temperature again appears in the display after the set waiting period.

10.3.7 General - Display of actual temperature in eco mode

Options:	No
	Yes

If the actual temperature is to be shown in ECO mode on the display, the parameter must be set on active. The device will then primarily display the actual temperature. When actuating the control element the display changes to the setpoint adjustment. After non-actuation of the control element the current actual temperature again appears in the display after the set waiting period.

10.3.8 Brightness setting – Day/Night mode

Options:	No
	Yes

Via the activated communication object "Day/Night" the backlighting of the display is shown bright during day mode and darker during night mode.



Note

The operation only applies to the display. It does not apply to the backlighting of the buttons.

10.3.9 Brightness setting – Brightness of display backlighting

Options:	Dark
	Bright

This can be used to define the brightness of the display backlighting independent of day or night mode.



Note

This parameter is only available if the "Day/Night mode" parameter is set on "No".

The operation only applies to the display. It does not apply to the backlighting of the buttons.

10.3.10 Extended settings - Colour scheme of display backlighting

Options:	Coloured
	Black and white

The device has a preset colour scheme for the room temperature controller. This means that the display indicates the modes.

- Set-point temperature < actual temperature = orange (warmer, heating)
- Set-point temperature > actual temperature = blue (colder, cooling)
- Set-point temperature = actual temperature = white (warmer, heating)
- ECO mode = green

If the colour concept is not required, the display can be selected in black and white. The display then does not indicate the specific statuses ("Heating" / "Cooling").



NOTE

The colour scheme of the display is not available for every version of the device. It is available for the following device versions:

- Millenium, 3,5"
- Busch-*priOn*[®]
- **Busch-ComfortPanel**[®]

10.4 Communication objects - RTC

10.4.1 Heating control value

Number	Name	Object function	Data type
1	Heating control value (control value heating/cooling)	Output	1. Switching 2. Percent (0 to 100%)

Description:

1. This object is used to operate a switching actuating drive, e.g. a thermoelectric positioner, that is controlled by a switching/heating actuator.
2. This object is used to control an actuating drive with a continuous input value (0%..100%), e.g. an electromotive actuating drive.

10.4.2 Additional heating stage

Number	Name	Object function	Data type
2	Additional heating stage (additional heating/cooling stage)	Output	1. Switching 2. Percent (0 to 100%)

Description:

1. This object is used to operate a switching actuating drive, e.g. a thermoelectric positioner, that is controlled by a switching/heating actuator.
2. This object is used to control an actuating drive with a continuous input value (0%..100%), e.g. an electromotive actuating drive.



Note

The additional stage can also be used as a parallel second heating stage. To do this, set the parameter for the temperature difference to the basic stage to 0°C.

10.4.3 Cooling control value

Number	Name	Object function	Data type
3	Cooling control value	Output	1. Switching 2. Percent (0 to 100%)

Description:

1. This object is used to operate a switching actuating drive, e.g. a thermoelectric positioner, that is controlled by a switching/heating actuator.
2. This object is used to control an actuating drive with a continuous input value (0%..100%), e.g. an electromotive actuating drive.

10.4.4 Additional cooling stage

Number	Name	Object function	Data type
4	Additional cooling stage	Output	1. Switching 2. Percent (0 to 100%)

Description:

1. This object is used to operate a switching actuating drive, e.g. a thermoelectric positioner, that is controlled by a switching/heating actuator.
2. This object is used to control an actuating drive with a continuous input value (0%..100%), e.g. an electromotive actuating drive.



Note

The additional stage can also be used as a parallel second cooling stage. To do this, set the parameter for the temperature difference to the basic stage to 0°C.

10.4.5 Control On/Off

Number	Name	Object function	Data type
5	1. Control On/Off	Output	Switching
	2. Control On/Off (master)	Output	Switching
	3. Control On/Off (slave)	Output	Switching

If a 0 telegram is received, the controller switches to OFF mode and regulates the temperature to the setpoint value for frost/heat protection. When the controller is switched on again, the remaining operating mode objects are queried in order to determine the new operating mode.



Note

About item 2:

During active ON/OFF controller function in master/slave mode the ON/OFF (master) control object is to be linked with this object.

About item 3:

During active ON/OFF controller function in master/slave mode the ON/OFF (slave) control object is to be linked with this object.

10.4.6 Actual temperature

Number	Name	Object function	Data type
6	1. Actual temperature	Output	2-byte floating point value
	2. Actual temperature weighted	Output	2-byte floating point value

1. The object outputs the measured (room) temperature, adjusted by the calibration value.
2. The object outputs the temperature value which is calculated from the recording and weighting of internal and up to two external temperatures.

**Note**

An external temperature measurement for room control may be practical for larger rooms and/or floor heating.

10.4.7 External actual temperature

Number	Name	Object function	Data type
7	External actual temperature	Input	2-byte floating point value

2-byte communication object for reading an external temperature value provided via the KNX bus.

10.4.8 External actual temperature 2

Number	Name	Object function	Data type
8	External actual temperature 2	Input	2-byte floating point value

2-byte communication object for reading an additional external temperature value provided via the KNX bus.

10.4.9 Fault, actual temperature

Number	Name	Object function	Data type
9	1. Fault, actual temperature	Output	Switching
	2. Fault, actual temperature (master)	Output	Switching
	3. Fault, actual temperature (slave)	Output	Switching

If one of the parameterized input temperatures is unavailable to the controller for a period longer than the monitoring time, the controller enters the error mode. The error mode is sent to the bus as the value 1.

**Note**

About item 2:

This object must be connected to the "Fault, actual temperature (slave)" object in order to indicate the error mode.

About item 3:

This object must be connected to the "Fault, actual temperature (slave)" object in order to indicate the error mode.

10.4.10 Local actual temperature

Number	Name	Object function	Data type
10	Local actual temperature	Output	Switching

Not visible!

10.4.11 Current setpoint

Number	Name	Object function	Data type
11	Current setpoint	Output	2-byte floating point value

The object outputs the current setpoint temperature resulting from the following: the parameterized setpoint temperature of the current operation type and operating mode, the manual setpoint temperature adjustment, a change in the base setpoint temperature via the base setpoint value object. This is purely a transmitting object.

10.4.12 Operating mode

Number	Name	Object function	Data type
12	1. Operating mode	Input / output	HVAC mode
	2. Operating mode (master)	Input / output	HVAC mode
	3. Operating mode (slave)	Input / output	HVAC mode

The "Operating mode" object receives, as a 1-byte value, the operating mode that is to be set. Here value 1 means "Comfort", value 2 "Standby", value 3 "Economy" and value 4 "Frost/heat protection".

In addition to manual setpoint adjustment and the adjustment of the basic setpoint value, the setpoint temperature of the controller can also be defined by objects "Superimposed operating mode", "Condensate ware alarm", "Dew alarm", "Window contact", "Control On/Off", "Presence detector" and "Operating mode (listed in decreasing order of priority).

**Note**

Item 2:

If the master/slave mode is the active operating mode, the Operating mode (slave) object must be connected to this object.

Item 3:

If the master/slave mode is the active operating mode, the operating mode (master) object must be connected to this object.

10.4.13 Superimposed operating mode

Number	Name	Object function	Data type
13	1. Superimposed operating mode	Input	HVAC mode
	2. Superimposed operating mode (master/slave)	Input	HVAC mode

The "Superimposed operating mode" object receives the operating mode that is to be set as 1-byte value. Here value 0 means "Superimposition inactive", value 1 "Comfort", value 2 "Standby", value 3 "Economy" and value 4 "Frost/heat protection".

In addition to manual setpoint adjustment and the adjustment of the basic setpoint value, the setpoint temperature of the controller can also be defined by objects "Superimposed operating mode", "Condensate water alarm", "Dew alarm", "Window contact", "Control On/Off", "Presence detector" and "Operating mode (listed in decreasing order of priority).



Note

Item 2:

If the master/slave mode is active, the "Superimposed operating mode" object of the master and the slave must be connected to the group address of the transmitter.

10.4.14 Window contact

Number	Name	Object function	Data type
14	1. Window contact	Input	Switching
	2. Window contact (master/slave)	Input	Switching

The object uses the value 1 to signal an open window to the controller. If no other object with a higher priority is present, then the "Window contact" message causes the controller to be set to the setpoint value for frost/heat protection. In addition to manual setpoint adjustment and the adjustment of the basic setpoint value, the setpoint temperature of the controller can also be defined by objects "Superimposed operating mode", "Condensate water alarm", "Dew alarm", "Window contact", "Control On/Off", "Presence detector" and "Operating mode (listed in decreasing order of priority).



Note

Item 2:

If the master/slave mode is active, the "Window contact (master/slave)" object of the master and the slave must be connected to the group address of the transmitter.

10.4.15 Presence detector

Number	Name	Object function	Data type
15	1. Presence detector	Input	Switching
	2. Presence detector (master/slave)	Input	Switching

This object transmits the value 1 to the controller to signal that there are people in the room. If not other object with a higher priority is present, then the "Presence detector" causes the controller to be set to the comfort setpoint value. In addition to manual setpoint adjustment and the adjustment of the basic setpoint value, the setpoint temperature of the controller can also be defined by objects "Superimposed operating mode", "Condensate water alarm", "Dew alarm", "Window contact", "Control On/Off", "Presence detector" and "Operating mode (listed in decreasing order of priority).

**Note**

Item 2:

If the master/slave mode is active, the "Presence detector (master/slave)" object of the master and the slave must be connected to the group address of the transmitter.

10.4.16 Heating status

Number	Name	Object function	Data type
16	Heating status	Output	Switching

The room temperature controller sends an ON telegram via the "Heating status" object as soon as it is active in the heating mode. If the controller is in the inactive zone between heating and cooling or is in cooling mode, the room temperature controller transmits an OFF telegram on the "Heating status" object.

10.4.17 Cooling status

Number	Name	Object function	Data type
17	Cooling status	Output	Switching

The room temperature controller sends an ON telegram via the "Cooling status" object as soon as it is active in the cooling mode. If the controller is in the inactive zone between heating and cooling or is in heating mode, the room temperature controller transmits an OFF telegram on the "Cooling status" object.

10.4.18 Basic load

Number	Name	Object function	Data type
16	Basic load	Input / output	Switching

This object uses the value 1 to activate a parameterized base load, i.e. a minimum control value greater than zero. The value 0 deactivates the base load. When the base load is deactivated, the control value can be lowered all the way to zero if necessary when the setpoint temperature is reached, despite the minimum value set in the parameter.

**Note**

Deactivating the basic load for a floor heating system is always useful in the summer, since it saves heating energy.

10.4.19 Switchover heating/cooling

Number	Name	Object function	Data type
17	Switchover heating/cooling	Input / output	Switching

1. Automatic: If the switchover between heating and cooling is performed automatically by the room temperature controller, then this object is used to provide information on the current heating (0) or cooling (1) status to the KNX bus. It is a transmitting object.
2. Only via object: The switchover between heating and cooling on the room temperature controller occurs solely via this 1-bit communication object. The value (0) activates the heating mode, and the value (1) activates the cooling mode. This is a receiving object.
3. Manual or via object: The switchover between heating and cooling on the room temperature controller occurs by user interaction or via the 1-bit communication object. The information on the respective heating (0) or cooling (1) status is available to the KNX bus. This is a receiving and sending object.

10.4.20 Fan coil manual

Number	Name	Object function	Data type
18	1. Fan coil manual	Output	Switching
	2. Fan coil manual (master)	Output	Switching
	3. Fan coil manual (slave)	Output	Switching

Using this 1-bit communication object, a fan coil actuator can be placed in manual fan mode or returned to automatic fan mode. In the automatic fan mode of the fan coil actuator, the fan's rotational speed is defined in the fan coil actuator using the control value. In manual fan operation, the user of the room temperature controller can set the fan's rotational speed as needed. This setting will remain active until it is reset. The fan speed level 0 is an exception: to avoid damage to the building, automatic mode is activated again 18 hours after fan speed level 0 is selected.



Note

Item 2:

If fan coil manual is active in the master/slave mode, the fan coil manual (slave) object must be connected to this object.

Item 3:

If fan coil manual is active in the master/slave mode, the fan coil manual (master) object must be connected to this object.

10.4.21 Fan coil step

Number	Name	Object function	Data type
19	1. Fan coil step	Output	2-byte floating point value
	2. Fan coil step (master)	Output	2-byte floating point value
	3. Fan coil step (slave)	Output	2-byte floating point value

The fan speed level in the fan coil actuator is selected via the 1-byte communication object. Whether the fan speed level information is transmitted in manual or also in automatic fan speed level mode can be set. The formats that can be selected for the 1-byte communication object are the fan speed level (0..5) or a percentage value (0..100%) which is calculated back to a fan speed level in the fan coil actuator.



Note

Item 2:

If fan coil step is active in the master/slave mode, the fan coil step (slave) object must be connected to this object.

Item 3:

If fan coil step is active in the master/slave mode, the fan coil step (slave) object must be connected to this object.

10.4.22 Fan coil step status

Number	Name	Object function	Data type
20	Fan coil step status	Input / output	2-byte floating point value

Using the "Fan coil step status" object, the room temperature controller receives the current fan speed level of the fan coil actuator.

10.4.23 Fan speed level 1

Number	Name	Object function	Data type
21	Fan speed level 1	Output	Switching

This 1-bit communication object is used to output the active status (1) of the fan speed level, while the other fan speed levels are deactivated (0), depending on the parameter setting. If the fan speed level is inactive, the object has a value of (0).

10.4.24 Fan speed level 2

Number	Name	Object function	Data type
22	Fan speed level 2	Output	Switching

This 1-bit communication object is used to output the active status (1) of the fan speed level, while the other fan speed levels are deactivated (0), depending on the parameter setting. If the fan speed level is inactive, the object has a value of (0).

10.4.25 Fan speed level 3

Number	Name	Object function	Data type
23	Fan speed level 3	Output	Switching

This 1-bit communication object is used to output the active status (1) of the fan speed level, while the other fan speed levels are deactivated (0), depending on the parameter setting. If the fan speed level is inactive, the object has a value of (0).

10.4.26 Fan speed level 4

Number	Name	Object function	Data type
24	Fan speed level 4	Output	Switching

This 1-bit communication object is used to output the active status (1) of the fan speed level, while the other fan speed levels are deactivated (0), depending on the parameter setting. If the fan speed level is inactive, the object has a value of (0).

10.4.27 Fan speed level 5

Number	Name	Object function	Data type
25	Fan speed level 5	Output	Switching

This 1-bit communication object is used to output the active status (1) of the fan speed level, while the other fan speed levels are deactivated (0), depending on the parameter setting. If the fan speed level is inactive, the object has a value of (0).

10.4.28 Basic setpoint

Number	Name	Object function	Data type
26	Basic setpoint	Input	2-byte floating point value

This 2-byte communication object can be used to change/adjust the parameterized basic setpoint value via the KNX bus. Parameters can be used to define whether the value received by this object is interpreted as "Setpoint heating comfort", "Setpoint cooling comfort" or an average between heating and cooling comfort.

10.4.29 Resetting manual setpoints

Number	Name	Object function	Data type
27	Resetting manual setpoints	Input	Switching

This 1-bit communication object is used to reset the manual setpoint adjustment that was set on the device.

10.4.30 Dew point alarm

Number	Name	Object function	Data type
28	Dew point alarm	Input	Switching

This 1-bit communication object is used to place the controller in the dew point alarm mode. This causes the current setpoint value to be set to the heat protection setpoint value in order to keep the structure from being damaged by dew.

**Note**

This protective mechanism is only active in the cooling mode. It remains in place until it is cancelled by the value (0). When an alarm is active, manual operation of the controller is blocked. This information is indicated by a corresponding icon on the control unit.

10.4.31 Condensate water alarm

Number	Name	Object function	Data type
29	1. Condensate water alarm	Input	Switching
	2. Condensate water alarm (master/slave)	Input	Switching

This 1-bit communication object is used to place the controller in the condensation alarm mode. This causes the current setpoint value to be set to the heat protection setpoint value in order to keep the structure from being damaged by an overflowing condensation container.



Note

Item 1:

This protective mechanism is only active in the cooling mode. It remains in place until it is cancelled by the value (0). When an alarm is active, manual operation of the controller is blocked. This information is indicated by a corresponding icon on the device.

Item 2:

- This protective mechanism is only active in the cooling mode. It remains in place until it is cancelled by the value (0). When an alarm is active, manual operation of the controller is blocked. This information is indicated by a corresponding icon on the device.
- When the master/slave mode is active, the condensate water alarm (master/slave) objects must be connected to the alarm transmitter.

10.4.32 Outside temperature for summer compensation

Number	Name	Object function	Data type
30	Outside temperature for summer compensation	Input	2-byte floating point value

In order to save energy, and to ensure that the temperature difference occurring during entry and exit of a climate-controlled building stays within comfortable limits, the reduction of room temperature by cooling devices should be limited as a function of the outside temperature (summer compensation). This, for example, prevents the air-conditioning system from further reducing the room temperature to 24°C with an outside temperature of 35°C.

This function can only be used with an outside temperature sensor. This 2-byte communication object must then be used to provide the controller with the current outside temperature.

10.4.33 Summer compensation active

Number	Name	Object function	Data type
31	Summer compensation active	Output	Switching

This 1-bit communication object is used to indicate via the bus whether the summer compensation is active (1) or inactive (0). If it is active, the setpoint value configured for the cooling mode is increased by the summer compensation function. A decrease of the cooling mode setpoint temperature below the value calculated by the parameterized summer compensation function is not possible. An increase of the setpoint temperature for the cooling mode is always possible.

10.4.34 Setpoint reached

Number	Name	Object function	Data type
32	Setpoint reached	Output	Switching

When the setpoint set on the device in comfort mode has been reached it is sent by means of value (1) as information to the KNX bus via the 1-bit communication object. The function is started by activating the comfort or presence mode. If the reaching of the setpoint temperature is interfered with by the preselection of a different operating mode or by adjustment to a new setpoint, value (0) is sent.

10.4.35 Fahrenheit

Number	Name	Object function	Data type
33	1. Fahrenheit	Input / output	Switching
	2. Fahrenheit (master)	Input / output	Switching
	3. Fahrenheit (slave)	Input / output	Switching

The temperature indication on the display can be changed from Celsius (°C) to Fahrenheit (°F). The conversion from Celsius to Fahrenheit always takes place in the display unit, since only Celsius values are sent over the KNX bus. The value (0) results in a temperature indication in Celsius, while the value (1) results in Fahrenheit.

**Note**

Item 2:

If the Fahrenheit object is active in the master/slave mode, the Fahrenheit (slave) object must be connected to this object.

Item 3:

If the Fahrenheit object is active in the master/slave mode, the Fahrenheit (master) object must be connected to this object.

10.4.36 Display backlighting

Number	Name	Object function	Data type
34	Display backlighting	Input / output	Switching

The display backlighting is activated with value (1) and deactivated with value (0) via the 1-bit communication object.

**Note**

This function is mainly used in rooms where backlighting during the night is considered to be a disturbing factor, such as in hotel rooms and bedrooms.

10.4.37 On/Off request

Number	Name	Object function	Data type
35	1. On/off request (master)	Input	Switching
	2. On/off request (slave)	Input	Switching

This 1-bit communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.38 Setpoint display

Number	Name	Object function	Data type
36	1. Setpoint display (master)	Input / output	2-byte floating point value
	2. Setpoint display (slave)	Input / output	2-byte floating point value

This 2-byte communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.39 Request setpoint

Number	Name	Object function	Data type
37	1. Request setpoint (master)	Input	Percent (0..100%)
	2. Request setpoint (slave)	Input	Percent (0..100%)

This 1-byte communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.40 Confirm setpoint

Number	Name	Object function	Data type
38	1. Confirm setpoint (master)	Input / output	Percent (0..100%)
	2. Confirm setpoint (slave)	Input / output	Percent (0..100%)

This 1-byte communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.41 Heating/cooling request

Number	Name	Object function	Data type
39	1. Heating/cooling request (master)	Input	Switching
	2. Heating/cooling request (slave)	Input	Switching

This 1-bit communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.42 Request fan speed level manual

Number	Name	Object function	Data type
40	1. Request fan speed level manual (master)	Input	Switching
	2. Request fan speed level manual (slave)	Input	Switching

This 1-bit communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.43 Request fan speed level

Number	Name	Object function	Data type
41	1. Request fan speed level (master)	Input	Percent (0..100%)
	2. Request fan speed level (slave)	Input	Percent (0..100%)

This 1-byte communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.44 Confirm fan speed level

Number	Name	Object function	Data type
42	1. Confirm fan speed level (master)	Input / output	Percent (0..100%)
	2. Confirm fan speed level (slave)	Input / output	Percent (0..100%)

This 1-byte communication object must be connected to the respective slave communication object in order to synchronise the devices in the master/slave configuration.

10.4.45 Controller status RHCC

Number	Name	Object function	Data type
43	Controller status RHCC	Output	2-byte floating point value

This communication object outputs the heating/cooling operation type, active/inactive operation, the frost and heat alarm, and the error (actual temperature reading failure) in accordance with the specification for the RHCC (Room Heating Cooling Controller) status.

10.4.46 Controller status HVAC

Number	Name	Object function	Data type
44	1. Controller status HVAC	Output	Percent (0..100%)
	2. Controller status HVAC (master)	Output	Percent (0..100%)
	3. Controller status HVAC (slave)	Output	Percent (0..100%)

This communication object outputs the current operating mode, the heating/cooling mode, active/inactive mode, the frost alarm and the dew point alarm in accordance with the specification for the HVAC (Heating Ventilation Air Conditioning) status.

**Note**

Item 2:

If the master/slave mode is active, the HVAC status (slave) object must be connected to this object.

Item 3:

If the master/slave mode is active, the HVAC status (master) object must be connected to this object.

10.4.47 Commissioned

Number	Name	Object function	Data type
45	Commissioned	Output	Switching

The controller uses this 1-bit communication object to send a cyclical "sign of life". This signal can be used to monitor the device, e.g. by means of a visualisation.

10.5 Additional RTC communication objects "Control settings"

10.5.1 Day/Night mode

Number	Name	Object function	Data type
47	Day/Night mode	–	Switching

Description:

Via the activated communication object "Day/Night" the backlighting of the display is shown bright during day mode and darker during night mode.

Note: The operation only applies to the display. It does not apply to the backlighting of the buttons.

10.6 Application for "Button top right"

10.6.1 Application "1-button switching"

When actuated or released a switching telegram is sent out. In each case, the application makes a separate set of parameters and communication objects available for the 1st and the 2nd button. The other side of the button can be assigned a further "button-oriented" function.

Parameter

General parameter	Setting options	Comments
Reaction on rising edge	<ul style="list-style-type: none"> ▪ On ▪ Off ▪ Alternating on/off ▪ No reaction 	–
Reaction on falling edge	<ul style="list-style-type: none"> ▪ On ▪ Off ▪ Alternating on/off ▪ No reaction 	–

Objects

No.	Object name	Data type	Flags
0	Switching	1 bit EIS1 / DPT 1.001	C, W ,T ,U

10.6.2 Application "1-button dimming"

The push-buttons have communication objects for switching and dimming. A distinction is made between a short (switching) and long (dimming) press of the button. In each case, the application makes a separate set of parameters and communication objects available for the 1st and the 2nd button. The application allows a lamp to be dimmed with the one button and the other button to be assigned with other "button-oriented" functions.

Parameter

General parameter	Setting options	Comments
Duration of long operation (s)	Time input from 0.3 to 3.0 seconds	General
Working mode of the buttons for switching	<ul style="list-style-type: none"> ▪ Deactivated ▪ Off ▪ On ▪ Alternating on/off 	Advanced
Working mode of the buttons for dimming	<ul style="list-style-type: none"> ▪ Alternating brighter/darker ▪ Darker ▪ Brighter 	

Objects

No.	Object name	Data type	Flags
0	Switching	1 bit EIS2 / DPT 1.001	C, W ,T ,U
1	Relative dimming	4 bit EIS2 / DPT 3.007	C, T

10.6.3 Application "2-button value transmitter"

With an actuation of the 1st or 2nd button a telegram with a predefined value is sent out. The application differentiates here between whether the 1st or 2nd button is actuated.

Parameter

General parameter	Setting options	Comments
Object type	<ul style="list-style-type: none"> ▪ 1 bit ▪ 1 byte 0 - 100% ▪ 1 byte 0 - 255 ▪ 2-byte float ▪ 2-byte signed ▪ 2-byte unsigned ▪ 4-byte float ▪ 4-byte signed ▪ 4-byte unsigned 	-
Working mode of the buttons	<ul style="list-style-type: none"> ▪ 1st button value 1, 2nd button value 2 ▪ 1st button value 2, 2nd button value 1 ▪ Alternating value1/value2 	
Value 1	For 1 bit	<ul style="list-style-type: none"> ▪ On ▪ Off
	For 1 byte 0 - 100%	0 - 100%
	For 1 byte 0 - 255	0 - 255
	For 2-byte float	-671088.6 - +670760.9
	For 2-byte signed	-32768 - +32767
	For 2-byte unsigned	0 - 65535
	For 4-byte float	-4000000 - +4000000
	For 4-byte signed	2147483648 - 2147483647
Value 2	For 4-byte unsigned	0 - 4294967295
	For 1 bit	<ul style="list-style-type: none"> ▪ On ▪ Off
	For 1 byte 0 - 100%	0 - 100%
	For 1 byte 0 - 255	0 - 255
	For 2-byte float	-671088.6 - +670760.9
	For 2-byte signed	-32768 - +32767
	For 2-byte unsigned	0 - 65535
	For 4-byte float	-4000000 - +4000000
For 4-byte signed	2147483648 - 2147483647	
For 4-byte unsigned	0 - 4294967295	

Description of application and parameters

Application for "Button top right"

Objects

No.	Object name	Data type	Flags
0	Switching value (1 bit)	1 bit EIS1 / DPT 1.001	C, W ,T ,U
	Switching value (1 byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W ,T ,U
	Switching value (1 byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W ,T ,U
	Switching value (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W ,T ,U
	Switching value (2-byte signed)	2 byte EIS10 / DPT 7.001	C, W ,T ,U
	Switching value (2-byte unsigned)	2 byte EIS10 / DPT 8.001	C, W ,T ,U
	Switching value (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W ,T ,U
	Switching value (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W ,T ,U
	Switching value (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W ,T ,U

10.6.4 Application "1-button value transmitter, 2 objects"

When actuating and/or releasing the buttons, two telegrams with predefined values are sent from two different communication objects. In each case, the application makes a separate set of parameters and communication objects available for the 1st and the 2nd button. The application makes it possible, for example, to send out a switching function and a floating point value when actuating one side of the button and to assign an additional "button-oriented" function to the other side of the button.

Parameter

General parameter	Setting options	Comments
Objcet type for rising edge	1 bit 1 byte 0 - 100% 1 byte (0 - 255) 2-byte float 2-byte signed 2-byte unsigned 4-byte float 4-byte signed 4-byte unsigned	–
Objcet type for falling edge	1 bit 1 byte 0 - 100% 1 byte (0 - 255) 2-byte float 2-byte signed 2-byte unsigned 4-byte float 4-byte signed 4-byte unsigned	–

Description of application and parameters

Application for "Button top right"

Additional Parameters	Setting options	Comments
Reaction on rising edge	No reaction Value 1 Value 2 Alternating value1/value2	–
Reaction on falling edge	No reaction Value 1 Value 2 Alternating value1/value2	–
Value 1 / 2 for a rising edge	–	Only available when parameter "Reaction to rising edge" is set on "Alternating value 1 / value 2".
	For 1 bit	<ul style="list-style-type: none"> ▪ On ▪ Off
	For 1 byte 0 - 100%	0 - 100 %
	For 1 byte 0 - 255	0 - 255
	For 2-byte float	-671088.6 - +670760.9
	For 2-byte signed	-32768 - +32767
	For 2-byte unsigned	0 - 65535
	For 4-byte float	-4000000 - +4000000
	For 4-byte signed	2147483648 - 2147483647
	For 4-byte unsigned	0 - 4294967295
Value 1 / 2 for falling edge	–	Only available when parameter "Reaction to falling edge" is set on "Alternating value 1 / value 2".
	For 1 bit	<ul style="list-style-type: none"> ▪ On ▪ Off
	For 1 byte 0 - 100%	0 - 100%
	For 1 byte 0 - 255	0 - 255
	For 2-byte float	-671088.6 - +670760.9
	For 2-byte signed	-32768 - +32767
	For 2-byte unsigned	0 - 65535
	For 4-byte float	-4000000 - +4000000
	For 4-byte signed	2147483648 - 2147483647
	For 4-byte unsigned	0 - 4294967295

Description of application and parameters

Application for "Button top right"

Objects

No.	Object name	Data type	Flags
0	Switching (rising edge) (1 bit)	1 bit EIS1 / DPT 1.001	C, W ,T ,U
	Switching (rising edge) (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W ,T ,U
	Switching (rising edge) (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W ,T ,U
	Switching (rising edge) (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W ,T ,U
	Switching (rising edge) (2-byte signed)	2 byte EIS10 / DPT 7.001	C, W ,T ,U
	Switching (rising edge) (2-byte unsigned)	2 byte EIS10 / DPT 8.001	C, W ,T ,U
	Switching (rising edge) (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W ,T ,U
	Switching (rising edge) (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W ,T ,U
	Switching (rising edge) (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W ,T ,U
1	Switching (falling edge) (1 bit)	1 bit EIS1 / DPT 1.001	C, W ,T ,U
	Switching (falling edge) (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W ,T ,U
	Switching (falling edge) (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W ,T ,U
	Switching (falling edge) (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W ,T ,U
	Switching (falling edge) (2-byte signed)	2 byte EIS10 / DPT 7.001	C, W ,T ,U
	Switching (falling edge) (2-byte unsigned)	2 byte EIS10 / DPT 8.001	C, W ,T ,U
	Switching (falling edge) (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W ,T ,U
	Switching (falling edge) (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W ,T ,U
	Switching (falling edge) (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W ,T ,U

10.6.5 Application "1-button light scene extension unit with memory function"

When a button is actuated a predefined light scene number is called up. In each case, the application makes a separate set of parameters and communication objects available for the 1st and the 2nd button. The application makes it possible to call up a light scene via one button side while the other button side can be assigned with a further "button-oriented" function. The user has the option to trigger a light scene memory command via a long actuation of the button.

Parameter

General parameter	Setting options	Comments
Duration of long operation (s)	Time input from 0.3 to 10.0 seconds	Only available when parameter "Light scene memory function" is set on "Activated".
Light scene memory function	<ul style="list-style-type: none"> ▪ Deactivated ▪ Activated 	–
Number of light scene	1 - 64	–

Objects

No.	Object name	Data type	Flags
0	Number of light scene	18.001 DPT_Scene_Control	C, W ,T ,U

10.6.6 Application "1-button step switch"

Different switching processes are triggered with each new actuation of the 1st or 2nd button.

For example:

- First actuation (2nd button) switches lamp 1 on.
- Second actuation (2nd button) switches lamp 1 off and lamp 2 on.
- Third actuation (2nd button) switches lamp 2 off and lamp 3 on.
- Fourth actuation (1st button) switches lamp 3 off and lamp 2 on.
- Fifth actuation (1st button) switches lamp 2 off and lamp 1 on.
- etc.

Up to five switching levels can be activated.

The application differentiates between whether the 1st or 2nd button was actuated. Depending on the setting, one lower or one higher level can be switched to.

Parameter

General parameter	Setting options	Comments
Number of objects	1 - 5	–
Evaluation period (s)	1.0 - 5.0	–

Additional Parameters	Setting options	Comments
Working mode of the buttons	<ul style="list-style-type: none"> ▪ 1st button Up, 2nd button Down ▪ 1st button Down, 2nd button Up 	–
Sending of objects	<ul style="list-style-type: none"> ▪ At actuation ▪ At change of value 	–
Object values	<ul style="list-style-type: none"> ▪ Normal ▪ Inverse 	–
Bit pattern of the object values	<ul style="list-style-type: none"> ▪ 1 off n ▪ x off n 	–

Objects

No.	Object name	Data type	Flags
0	Switching step 1	1 bit EIS1 / DPT 1.001	C, W, T
1	Switching step 2	1 bit EIS1 / DPT 1.001	C, W, T
2	Switching step 3	1 bit EIS1 / DPT 1.001	C, W, T
3	Switching step 4	1 bit EIS1 / DPT 1.001	C, W, T
4	Switching step 5	1 bit EIS1 / DPT 1.001	C, W, T

10.6.7 Application "1-button short-long operation"

The application makes two separate functions available on one side of the button which can be called up via a short or long button press, while the other side of the button can be assigned a further "button-oriented" function. In each case, the application makes a separate set of parameters and communication objects available for the 1st and the 2nd button.

Parameter

General parameter	Setting options	Comments
Object type	<ul style="list-style-type: none"> ▪ 1 bit ▪ 1 byte 0 - 100% ▪ 1 byte 0 - 255 ▪ 2-byte float ▪ 2-byte signed ▪ 2-byte unsigned ▪ 4-byte float ▪ 4-byte signed ▪ 4-byte unsigned 	General
Reaction on short operation	<ul style="list-style-type: none"> ▪ No reaction ▪ Value 1 ▪ Value 2 ▪ Alternating value1/value2 	
Reaction on long operation	<ul style="list-style-type: none"> ▪ No reaction ▪ Value 1 ▪ Value 2 ▪ Alternating value1/value2 	
Duration of long operation (s)	Time input from 0.3 to 3.0 seconds	Advanced

Objects

No.	Object name	Data type	Flags
0	Switching value for short operation	4 byte EIS14 / DPT 12.001	C, W ,T ,U
1	Switching value for long operation	4 byte EIS14 / DPT 12.001	C, W ,T ,U

10.7 Application for "General functions"**10.7.1 Cyclic telegram**

Via the "Cyclic telegram" application and after receipt of a telegram on the "Input" object, a telegram with the same volume is cyclically sent out on the "Cyclic output" object. The object types for "Input" and "Output" can be collectively parameterised for the different applications. The times for cyclic sending on the "Output" object are adjustable. An additional "Enable" object provides the option of temporarily blocking the function.

Cyclic telegram objects

No.	Object name	Data type	Flags
0	Input (1-bit switching)	1 bit EIS1 / DPT 1.001	C, W
	Input (1-bit alarm)	1 bit EIS1 / DPT 1.001	C, W
	Input (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W
	Input (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W
	Input (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W
	Input (2-byte signed)	2 byte EIS10 / DPT 8.001	C, W
	Input (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, W
	Input (2-byte temperature)	2 byte EIS5 / DPT 9.001	C, W
	Input (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W
	Input (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W
	Input (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W
1	Output (1-bit switching)	1 bit EIS1 / DPT 1.001	C, T
	Output (1-bit alarm)	1 bit EIS1 / DPT 1.001	C, T
	Output (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, T
	Output (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, T
	Output (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, T
	Output (2-byte signed)	2 byte EIS10 / DPT 8.001	C, T
	Output (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, T
	Output (2-byte temperature)	2 byte EIS5 / DPT 9.001	C, T
	Output (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, T
	Output (4-byte signed)	4 byte EIS11 / DPT 13.001	C, T
	Output (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, T
2	Enable	1 bit EIS1 / DPT 1.001	C, W

10.7.2 Priority

The "Priority" application has 3 communication objects, a 1-bit object "Switch input", a 2-bit object "Input priority" and a 1-bit object "Output". The telegrams received on the "Switch input" are transferred to the "Output" depending on the state of the "Input priority" object.

The 2-bit object "Input priority" can receive and differentiate between four different values (0, 1, 2 and 3). Here, the "Output" object is positively driven. Three different states are differentiated:

- "Input priority" has value "3": the value that is present on "Switch input" has no meaning. The "Output" is switched to positively driven and has the value "1".
- "Input priority" has the value "2". The value that is present on "Switch input" has no meaning. The "Output" is switched off positively driven and has the value "0".
- "Input priority" has the value "1" or "0". The "Output" is not positively driven. The "Switch input" is linked to the status bit of the priority object OR and transferred to the "Output".

During a positive drive, changes of the "Switch input" object are saved, even if the current state on the "Output" object does not immediately change through this. If the positive drive is terminated, a telegram transmission on the "Output" occurs according to the current value of the "Switch input" object.

Priority objects

No.	Object name	Data type	Flags
0	Switch input	1 bit EIS1 / DPT 1.001	C, W
1	Priority input	2 bit EIS8 / DPT 2.001	C, W
2	Output	1 bit EIS1 / DPT 1.001	C, T

10.7.3 Logic**Logic objects**

No.	Object name	Data type	Flags
0	Output (1 bit)	1 bit EIS1 / DPT 1.001	C, W, T
	Output (1 byte)	1 byte EIS14 / DPT 5.010	C, W, T
1	Input 1 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 1 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
2	Input 2 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 2 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
3	Input 3 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 3 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
4	Input 4 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 4 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
5	Input 5 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 5 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
6	Input 6 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 6 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
7	Input 7 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 7 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
8	Input 8 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 8 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
9	Input 9 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 9 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U
10	Input 10 (1 bit)	1 bit EIS1 / DPT 1.001	C, W, U
	Input 10 (1 byte)	1 byte EIS14 / DPT 5.010	C, W, U

10.7.4 Gate

The "Gate" application allows specific signals to be filtered and the signal flow to be temporarily blocked. The function has three communication objects: "Control input", "Input" and "Output".

The input or output object can assume different sizes.

The bit size can be freely assigned with the "Not assigned" setting. This means that the first internal or external group address/action that is assigned and already connected to some other communication object will specify the size.

The control can occur from "Input to output" or also from "Output to input", provided the control input allows this. Enabling via the control input can occur via an ON or an OFF telegram.

If, for example, the "Control input" setting is set to "ON telegram", only telegrams from the input are transmitted to the output, if prior to this the control input has received an ON telegram.

It is also possible to block signals via the "Filter function" setting. Either "nothing is filtered out" or the signal "ON is filtered out" or the signal "OFF is filtered out". This function is always necessary, for example, when only the ON telegram is interesting for a sensor and the sensor does not offer any filter function in its application program.

Gate objects

No.	Object name	Data type	Flags
0	Input	–	C, W, T
1	Output	–	C, W, T
2	Control input	1 bit EIS1 / DPT 1.001	C, W

10.7.5 Staircase lighting

With the "Staircase lighting" application, switching telegrams or value telegrams can be provided with a switch-off delay. Depending on the parameterisation, the application shows different communication objects:

- a 1-bit object for input and output

If an ON telegram is received via the "Input/Output" object, the switch-off delay is started immediately. This can be a switch-off delay of 10 seconds to 88:45 minutes, which is adjustable in 1-second steps. After expiration of the switch-off delay, the "Input/Output" object sends an OFF telegram.

- two 1-bit objects for input and output
- two 1-byte objects for input and output

If a telegram is received via the "Input" object, the switch-off delay is started immediately and a telegram with the same value of the telegram received on the input is sent out on the "Output" object. This can be a switch-off delay of 10 seconds to 88:45 minutes, which is adjustable in 1-second steps. After expiration of the switch-off delay, the "Output" object sends out an OFF telegram (1-bit) or a telegram with the value "0" (1-byte).

Via two additional communication objects, it is possible to specify the switch-off delay and the switch-off prewarning time. The values received are written to the memory of the device and are retained even after a power failure and subsequent return of voltage.

Staircase lighting objects

No.	Object name	Data type	Flags
0	Input (1 bit)	1 bit EIS1 / DPT 1.001	C, W
	Input (1 byte)	1 bit EIS14 / DPT 5.010	C, W
	Input_output (1 bit)	1 bit EIS1 / DPT 1.001	C, W, T
1	Switch-off delay (2 byte)	2 byte EIS10 / DPT 7.001	C, R, W
2	Switch-off prewarning (2 byte)	2 byte EIS10 / DPT 7.001	C, R, W
3	Output (1 bit)	1 bit EIS1 / DPT 1.001	C, T
	Output (1 byte)	1 bit EIS14 / DPT 5.010	C, T

10.7.6 Delay

Telegrams can be received via the "Input" object using the "Delay" application. The telegrams received are sent out on the "Output" object with a set delay time.

The object types for "Input" and "Output" can be collectively parameterised for the different applications.

Delay objects

No.	Object name	Data type	Flags
0	Input (1 bit)	1 bit EIS1 / DPT 1.001	C, W
	Input (1 bit)	1 bit EIS7 / DPT 1.008	C, W
	Input (1 bit)	1 bit EIS7 / DPT 1.007	C, W
	Input (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W
	Input (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W
	Input (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W
	Input (2-byte signed)	2 byte EIS10 / DPT 8.001	C, W
	Input (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, W
	Input (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W
	Input (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W
	Input (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W
1	Output (1 bit)	1 bit EIS1 / DPT 1.001	C, T
	Output (1 bit)	1 bit EIS7 / DPT 1.008	C, T
	Output (1 bit)	1 bit EIS7 / DPT 1.007	C, T
	Output (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, T
	Output (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, T
	Output (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, T
	Output (2-byte signed)	2 byte EIS10 / DPT 7.001	C, T
	Output (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, T
	Output (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, T
	Output (4-byte signed)	4 byte EIS11 / DPT 13.001	C, T
	Output (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, T
2	Delay time (2 byte)	2 byte EIS10 / DPT 7.001	C, R, W

10.7.7 Min/Max value transducer

Up to eight input values can be compared with each other using the "Min/max value transducer" application. The application can output the highest input value, the smallest input value or the average of all input values on the output.

The size of the input objects, and with it also the size of the output object can be adapted for the most diverse applications. You can select from the following object types:

- 1-byte 0 - 100%, for comparison of percentage values
- 1-byte 0 - 255, for the comparison of decimal values between 0 and 255
- 2-byte float, for the comparison of 2-byte floating point values (physical values such as temperature, brightness value, etc.)
- 2-byte signed, for the comparison of decimal values between -32,768 and +32,767
- 2-byte unsigned, for the comparison of decimal values between 0 and 65,535
- 4-byte float, for the comparison of 4-byte floating point values (physical values such as acceleration, electrical current, work, etc.)
- 4-byte signed, for the comparison of decimal values between -2,147,483,648 and 2,147,483,647
- 4-byte unsigned, for the comparison of decimal values between 0 and 4,294,967,295



NOTE

With whole numbers the average value is rounded.

Min/Max value transducer objects

No.	Object name	Data type	Flags
0	Output (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, T
	Output (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, T
	Output (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, T
	Output (2-byte signed)	2 byte EIS10 / DPT 8.001	C, T
	Output (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, T
	Output (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, T
	Output (4-byte signed)	4 byte EIS11 / DPT 13.001	C, T
	Output (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, T
1 - 10	Input 1 [2 - 8] (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W
	Input 1 [2 - 8] (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W
	Input 1 [2 - 8] (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W
	Input 1 [2 - 8] (2-byte signed)	2 byte EIS10 / DPT 8.001	C, W
	Input 1 (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, W
	Input 1 [2 - 8] (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W
	Input 1 [2 - 8] (4-byte signed)	4 byte EIS11 / DPT 13.001	C, W
	Input 1 [2 - 8] (4-byte unsigned)	4 byte EIS11 / DPT 12.001	C, W

10.7.8 Threshold value / hysteresis

With the "Threshold value / Hysteresis" application, value telegrams can be received on an input communication object and compared with threshold values specified in the device.

Predefined values are sent out on the "Output" communication object if the upper threshold is exceeded or the lower threshold drops below the set value. The size of the object can be adjusted for different applications.

The function can be temporarily blocked via an enable object.

If the value of the lower threshold lies above the value for the upper threshold, the function is not executed.

Threshold value / hysteresis objects

No.	Object name	Data type	Flags
0	Input (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W
	Input (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, W
	Input (2-byte float)	2 byte EIS5 / DPT 9.xxx	C, W
	Input (2-byte signed)	2 byte EIS10 / DPT 8.001	C, W
	Input (2-byte unsigned)	2 byte EIS10 / DPT 7.001	C, W
	Input (4-byte float)	4 byte EIS9 / DPT 14.xxx	C, W
	Input (4-byte signed)	4 byte EIS11 / DPT 12.001	C, W
	Input (4-byte unsigned)	4 byte EIS11 / DPT 13.001	C, W
1	Output (1 bit)	1 bit EIS1 / DPT 1.001	C, T
	Output (1-byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, T
	Output (1-byte 0 - 255)	1 byte EIS14 / DPT 5.010	C, T
2	Enable	1 bit EIS1 / DPT 1.001	C, W

10.7.9 Light scene actuator

With the "Light scene actuator" application it is possible to call up scenes that are stored in the device via the receipt of a scene number on the 1-byte communication object "Scene call-up". A maximum of eight scenes with up to eight actuator objects can be created.

For triggering different actuators, the size of the actuator groups communication objects can be set under the "Actuator group type" parameter.

The user has the option of saving the scenes himself. A corresponding save telegram must be received for this (see the description of the individual parameters).

Light scene actuator objects

No.	Object name	Data type	Flags
0	Light scene call-up (1 byte)	1 byte / DPT18.001	C, W, U
1 - 10	Actuator group A [B - J] (1-bit switching)	1 bit EIS1 / DPT 1.001	C, W ,T ,U
	Actuator group A [B - J] (1-bit blind)	1 bit EIS7 / DPT 1.008	C, W ,T ,U
	Actuator group A [B - J] (1 byte 0 - 100%)	1 byte EIS6 / DPT 5.001	C, W ,T ,U
	Actuator group A [B - J] (1-byte light scene number)	1 byte / DPT 18.001	C, W ,T ,U
	Actuator group A [B - J] (Temperature value absolute)	2 byte EIS5 / DPT 9.001	C, W ,T ,U
10 - 19	Enable scene 1 [Scene 2 - Scene 10]	1 bit EIS1 / DPT 1.001	C, W, T

11 Index

A	
Actual temperature	80
Additional alarms	32
Additional components	16
Additional cooling stage	54, 80
Additional cooling stage - Control value difference for sending of cooling control value	55
Additional cooling stage - Cyclic sending of the control value (min)	55
Additional cooling stage - Hysteresis (x 0.1°C)	54
Additional cooling stage - Maximum control value (0 - 255)	55
Additional cooling stage - Minimum control value for basic load (0 - 255)	56
Additional cooling stage - Mode of the control value	54
Additional functions	36
Additional heating stage	44, 79
Additional heating stage - Control value for sending of heating control value	45
Additional heating stage - Cyclic sending of the control value (min)	46
Additional heating stage - Hysteresis (x 0.1°C)	45
Additional heating stage - Minimum control value for basic load (0 - 255)	46
Additional heating stage - Mode of control value	44
Additional operating modes	32
Additional RTC application "Control settings"	75
Additional RTC communication objects "Control settings"	94
Alarm functions	67
Alarm functions - Dew point alarm	68
Alarm functions - Frost alarm temperature for HVAC and RHCC status (°C)	68
Alarm functions - Heat alarm temperature for RHCC status (°C)	68
Alarmfunktionen — Kondenswasseralarm	67
Application	73
Application "1-button dimming"	96
Application "1-button light scene extension unit with memory function"	102
Application "1-button short-long operation"	104
Application "1-button step switch"	103
Application "1-button switching"	95
Application "1-button value transmitter, 2 objects"	99
Application "2-button value transmitter"	97
Application "RTC"	35
Application for "Button top right"	95
Application for "General functions"	105
Application program	34
Assigning a physical address	24
Assigning the group address(es)	24
B	
Backlighting	26
Basic load	85
Basic setpoint	88
Basic stage cooling	49, 51
Basic stage cooling - Cyclic sending of the control value (min)	50
Basic stage cooling - Hysteresis (x 0.1°C)	50
Basic stage cooling - Maximum control value (0 - 255)	51
Basic stage cooling - Minimum control value for basic load (0 to 255)	51
Basic stage cooling - Mode of the control value	49
Basic stage cooling - Status object cooling	49
Basic stage heating	39
Basic stage heating - Control value difference for sending of heating control value	40
Basic stage heating - Cyclic sending of the control value (min)	40
Basic stage heating - Hysteresis (x 0.1°C)	40
Basic stage heating - Maximum control value (0 - 255)	41
Basic stage heating - Minimum control value for basic load (0 to 255)	41
Basic stage heating - Mode of control value	39
Basic stage heating - PWM cycle heating (min)	41
Basic stage heating - Status object heating	39
Brightness setting - Brightness of display backlighting	77
Brightness setting - Day/Night mode	77
Bus/network coupler, flush-mounted	16
Button backlighting	26
C	
Cleaning	33
Colling control value	79
Combined heating and cooling modes	56
Combined heating and cooling modes - Heating/cooling control value output	57
Combined heating and cooling modes - Operating mode after reset	57
Combined heating and cooling modes - Switchover of heating/cooling	57
Commissioned	93
Commissioning	24
Communication objects - RTC	79
Condensate water alarm	89
Confirm fan speed level	92
Confirm setpoint	91
Connection, installation / mounting	16, 18
Control elements	25
Control function	35
Control of additional cooling stage	52
Control of additional cooling stage - Cooling type	53
Control of additional cooling stage - Extended settings	54
Control of additional cooling stage - P-component (min)	53
Control of additional cooling stage - P-component (x 0.1°C)	53
Control of additional heating stage	41
Control of additional heating stage - Additional heating type	43
Control of additional heating stage - Control value type	42
Control of additional heating stage - Extended settings	44
Control of additional heating stage - P-component (min)	44

Control of additional heating stage - P-component (x 0.1°C)	43	Fan coil settings heating - Fan speed level 1 to 5 up to control value (0 to 255) heating.....	70
Control of heating with additional stage - Temperature difference to basic stage (x 0.1°C)	44	Fan coil step status	87
Control On/Off	80	Fan speed level 1	87
Controller status HVAC	93	Fan speed level 2	87
Controller status RHCC	93	Fan speed level 3	87
Cooling control	47	Fan speed level 4	87
Cooling control - Control value type	47	Fan speed level 5	88
Cooling control - Cooling type	48	Fan speed level for cooling - Fan speed level 1 to 5 up to control value (0 to 255) cooling	71
Cooling control - Extended settings	49	Fan speed settings for cooling - Maximum fan speed level cooling for eco mode	71
Cooling control - I-component (min.)	48	Fancoil step	86
Cooling control - P-component (x 0.1°C)	48	Fault, actual temperature	81
Cooling status	84	Features of equipment	14
Cover frame	16	Features of functions	14
Current setpoint	82		
Cyclic telegram	105		
D		G	
Day/Night mode	94	Gate	108
Delay	110	General - Display of actual temperature	76
Description of application	10, 24, 34	General - Display of actual temperature in eco mode	76
Description of objects	10, 24, 34	General - Jump-back to the primary function	75
Description of parameters	10, 24, 34	General - Operating mode after reset	36
Device function	35	General - Setpoint display	75
Device overview	16	General - Setting the temperature unit via object	75
Dew point alarm	88	General - Waiting period for display of actual temperature ..	76
Differentiating the application program	24	General control and display functions	27
Dimensional drawings	17		
Display backlighting	91	H	
Displays	26	Heating control	37
		Heating control - Control value type	37
E		Heating control - Extended settings	39
Electrical connection	23	Heating control - Heating type	38
Environment	13	Heating control - I-component (min.)	39
Extended settings - Colour scheme of display backlighting ..	78	Heating control - P-component (x 0.1°C)	38
External actual temperature	81	Heating control value	79
External actual temperature 2	81	Heating status	84
		Heating/cooling request	92
F			
Fahrenheit	90	I	
Fan coil manual	86	Improper use	10
Fan coil settings - Fan speed levels	68	Information and symbols used	9
Fan coil settings - Fan speed levels - Format of the level output	69	Information on protection of the environment	13
Fan coil settings - Fan speed levels - Level output	69	Installation site	19
Fan coil settings - Fan speed levels - Level status evaluation	70	Installing the label	22
Fan coil settings - Fan speed levels - Lowest manually adjustable level	69	Installing the unit	21
Fan coil settings - Fan speed levels - Number of fan speed levels	68	Intended use	10
Fan coil settings for cooling	71		
Fan coil settings for cooling - Fan speed level limit cooling for eco mode	71	L	
Fan coil settings for heating - Fan speed level limit heating for eco mode	70	Light scene actuator	113
Fan coil settings for heating - Maximum speed level heating for eco mode	71	Local actual temperature	81
Fan coil settings heating	70	Logic	107
		M	
		Maintenance	33
		Maintenance-free device	33
		Messages	26
		Min/Max value transducer	111
		Mounting	21

N		
Notes on the instruction manual	8	
O		
On/Off request	91	
Operating mode	82	
Operating the room temperature controller	29	
Operation	11, 25	
Outside temperature for summer compensation	89	
P		
Presence detector	84	
Priority	106	
Q		
Qualification of personnel	11	
R		
Request fan speed level	92	
Request fan speed level manual	92	
Request setpoint	91	
Requirements for the electrician	18	
Resetting manual setpoints	88	
Rocker switch function	29	
S		
Safety	9	
Safety instructions	12	
Selecting the application program	24	
Send cyclic "In operation" (min)	37	
Setpoint adjustment	62	
Setpoint adjustment - Maximum manual increase during cooling mode (0 - 15°C)	63	
Setpoint adjustment - Maximum manual increase during heating mode (0 - 15°C)	62	
Setpoint adjustment - Maximum manual reduction during cooling mode (0 - 15°C)	63	
Setpoint adjustment - Maximum manual reduction during heating mode (0 - 15°C)	62	
Setpoint adjustment - Permanent storage of on-site operation	64	
Setpoint adjustment - Resetting of the manual adjustment for receipt of a basic setpoint	63	
Setpoint adjustment - Resetting the manual adjustment for change of operating mode	64	
Setpoint adjustment - Resetting the manual adjustment via object	64	
Setpoint display	91	
Setpoint reached	90	
Setpoint settings	58	
Setpoint settings - Cyclic sending of the current set-point temperature (min)	62	
Setpoint settings - Display indicates	61	
Setpoint settings - Hysteresis for switchover heating/cooling	59	
Setpoint settings - Increase for ECO cooling (°C)	61	
Setpoint settings - Increase for standby cooling (°C)	60	
Setpoint settings - Reduction for ECO heating (°C)	60	
Setpoint settings - Reduction for standby heating (°C)	59	
Setpoint settings - Send current setpoint	62	
Setpoint settings - Setpoint for heating comfort = setpoint for cooling comfort	58	
Setpoint settings - Setpoint temperature for cooling comfort (°C)	60	
Setpoint settings - Set-point temperature for frost protection (°C)	60	
Setpoint settings - Set-point temperature for heat protection (°C)	61	
Setpoint settings - Setpoint temperature for heating and cooling comfort (°C)	59	
Setpoint settings - Setpoint temperature for heating comfort (°C)	59	
Settings of basic load	56	
Settings of basic load - Minimum control value for basic load > 0	56	
Setup and function	14	
Software	24	
Staircase lighting	109	
Summer compensation	72	
Summer compensation - (Lower) Starting temperature for summer compensation (°C)	73	
Summer compensation - Offset of the set-point temperature for the entry into summer compensation (x 0.1°C)	73	
Summer compensation - Offset of the set-point temperature for the exit from summer compensation (x 0.1°C)	74	
Summer compensation - Summer compensation	72	
Summer compensation active	90	
Superimposed operating mode	83	
Switchover heating/cooling	85	
T		
Target group	11	
Technical data	17	
Temperature display – Temperature unit	75	
Temperature reading - Adjustment value for internal temperature measurement (x 0.1°C)	66	
Temperature reading - Control value for fault (0 - 255)	67	
Temperature reading - Cyclic sending of actual temperature (min)	66	
Temperature reading - Difference of value for sending the actual temperature (x 0.1°C)	66	
Temperature reading - Inputs of temperature reading	64	
Temperature reading - Inputs of weighted temperature reading	65	
Temperature reading - Monitoring time for temperature reading (0 = no monitoring) (min)	66	
Temperature reading - Operating mode for fault	67	
Temperature reading - Weighting of external measurement (0 to 100%)	65	
Temperature reading - Weighting of external measurement 2 (0 to 100%)	65	
Temperature reading - Weighting of internal measurement (0 to 100%)	65	
Threshold value / hysteresis	112	
W		
Window contact	83	

A member of the ABB Group

Busch-Jaeger Elektro GmbH
PO box
58505 Lüdenscheid

Freisenbergstraße 2
58513 Lüdenscheid

www.BUSCH-JAEGER.com
info.bje@de.abb.com

Central sales service:
Tel.: +49 2351 956-1600
Fax: +49 2351 956-1700

Notice

We reserve the right to make technical changes at all times as well as changes to the contents of this document without prior notice. The detailed specifications agreed upon apply for orders. ABB accepts no responsibility for possible errors or incompleteness in this document.

We reserve all rights to this document and the topics and illustrations contained therein. The document and its contents, or extracts thereof, must not be reproduced, transmitted or reused by third parties without prior written consent by ABB

Copyright© 2015 Busch-Jaeger
Elektro GmbH
All rights reserved